


BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

Issue of NOC for Arranging Power Supply to Proposed Residential Apartment to an extent 19981KW(23507KVA) in favour of M/s Prestige Projects Pvt Ltd at Sy Nos 6/5, 13/1, 13/2, 13/4, 18, 19, 20, 21, 22, 23, 24/1, 24/2, 25/1, 25/2, 26/1A, 26/1B, 26/1C, 26/2, 27, 28, 29/1, 29/2, 29/3, 30, 31, 32/1, 32/2, 32/3, 32/4, 35/3, 37/1, 37/2 of Yamare Village 19/2, 19/3, 9/4, 20/1, 20/2, 21/2, 21/2, 21/3, 21/4, 21/5, 22/1, 22/2A, 22/2B, 22/3, 23/2, 23/3, 23/4, 23/5, 24/1, 24/2, 24/3, 25, 26, 29/2, 29/3A2, 29/3A3, 29/6, 29/7, 30/1, 30/2, 31/1, 31/2, 32/2, 32/1, 32/2, 32/3, 32/5, 33, 35, 36, 37, 38/2, 38/3, 38/4, 54, 55, 56, 57, 58, 59/3, 59/4, 62, 63/1, 63/2, 63/3, 63/4, 63/5, 63/6, 63/7, 63/8 of Valagere Kallahalli Village, Sarjapura Hobli, Anekal Taluk, Bangalore District, Anekal Taluk in Sarjapura O&M of Attibele Sub division (Under Self Execution Works).

Sketch:

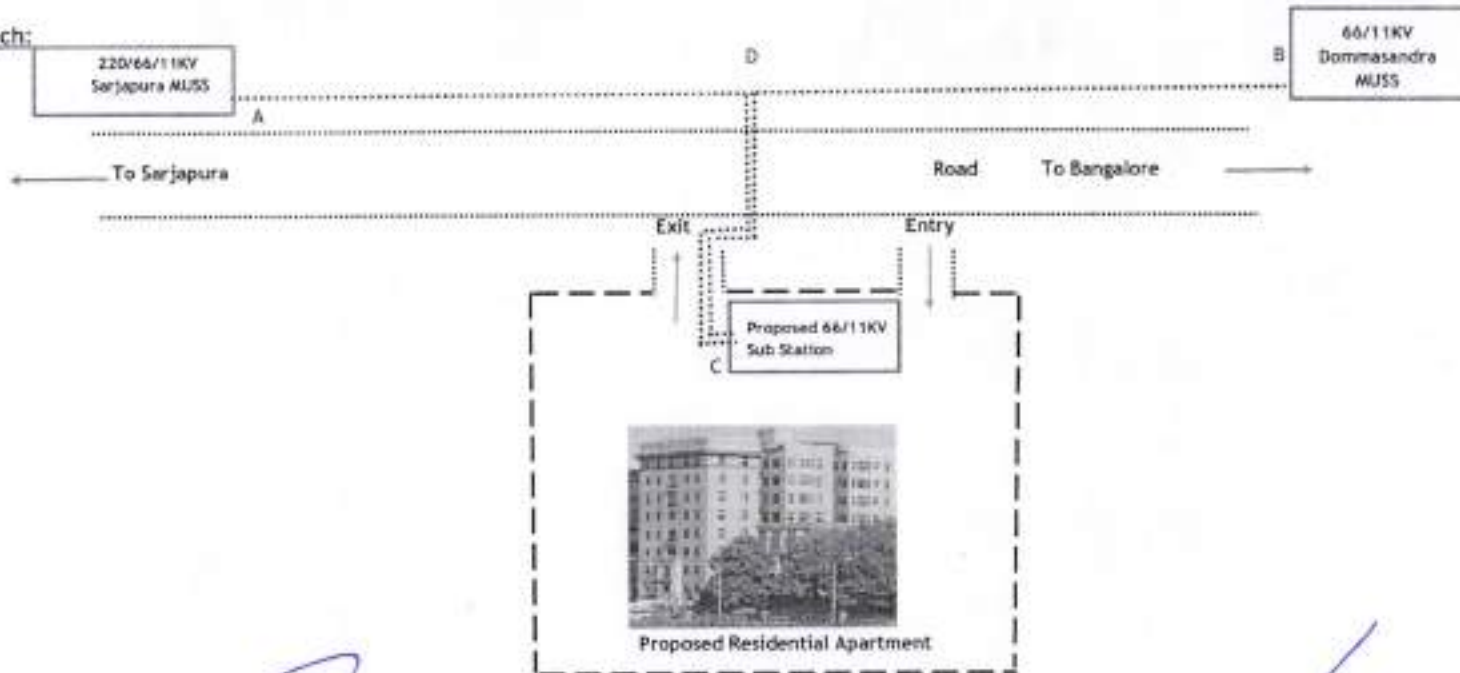

Index

Proposed 66KV 1000 Sqmm UG Cable to a distance of 4 Kms from Point D to C (Loop In Loop Out)

Assistant Engineer (Elec)
Sarjapura O&M
Attibele Sub-Division

Asst Executive Engineer (Elec)
BESCOM, Attibele Sub-Division,
BESCOM, Bangalore

ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ನಿಗಮ (ಬಿ.ಎ.ಸಿ.)
ಆರೋಗ್ಯಕರ ಮತ್ತು
ಪ್ರಗತಿಶೀಲ

BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED.

Estimate No:AE/O & M/SJP-

Date:06.08.2021

Issue of NOC for Arranging Power Supply to Proposed Residential Apartment to an extent 19981KW(23507KVA) in favour of M/s Prestige Projects Pvt Ltd at Sy Nos 6/5, 13/1, 13/2, 13/4, 18, 19, 20, 21, 22, 23, 24/1, 24/2, 25/1, 25/2, 26/1A, 26/1B, 26/1C, 26/2, 27, 28, 29/1, 29/2, 29/3, 30, 31, 32/1, 32/2, 32/3, 32/4, 35/3, 37/1, 37/2 of Yamare Village 19/2, 19/3, 9/4, 20/1, 20/2, 21/2, 21/3, 21/4, 21/5, 22/1, 22/2A, 22/2B, 22/3, 23/2, 23/3, 23/4, 23/5, 24/1, 24/2, 24/3, 25, 26, 29/2, 29/3A2, 29/3A3, 29/6, 29/7, 30/1, 30/2, 31/1, 31/2, 32/2, 32/1, 32/2, 32/3, 32/5, 33, 35, 36, 37, 38/2, 38/3, 38/4, 54, 55, 56, 57, 58, 59/3, 59/4, 62, 63/1, 63/2, 63/3, 63/4, 63/5, 63/6, 63/7, 63/8 of Valagere Kallahalli Village, Sarjapura Hobli, Anekal Taluk, Bangalore District, Anekal Taluk in Sarjapura O&M of Attibele Sub division (Under Self Execution Works).

Report :-

M/s Prestige Projects Pvt Ltd at Sy Nos 37 & Others of Yamare and V.Kallahalli Village of Anekal Taluk has requested to issue of NOC for Requested load of 19981KW(23507KVA) for Proposed Residential Apartment. The Proposed Residential Apartment Consists of Parcel 1 to (Villas, Building 1 to 6) the Details as follows.

Proposals:

The following Proposals are made under self execution to cater the required load.

It is Proposed to Tap the 66KV line in between 220/66/11KV Sarjapura Sub Station and 66/11KV Dommasandra Station at Point C and Proposed to Extend the 66KV line using 66KV, 1000 Sqmm UG Cable and to a distance of 4 KM(Loop in Loop Out) Upto the Proposed Site. further applicant to construct 66/11KV Sub station in their premises under self execution.

2 It is Certified that,

- There is no IP sets existing in this Premises.
- There is no long disconnected installation existing in this Premises.
- There is no lake inside/near to this Premises.
- There is no LT/HT/EHT lines crossing in this Premises.
- Sufficient space is available in Applicant premises for Construction of 66/11KV Sub Station, erection Of TC Centers, Metering Cubicle, RMU, Etc

3 Area Details as Follows

Net Site Area = 85 Acres and 26 Guntas = 346611.85 Sq Mtrs

Parcel-1: Villa

S.No	Particulars	No of Units	Requested Load in KW	Total load in KW
1	Type A1 & A2 4BHK	134	6	804
2	Type A1 & A2 4BHK	15	5	75
3	Common Main-01	1	65	65
4	Common Main-02	1	70	70
Total Units and Total Load		151		1014

Parcel-2: Apartment: Building 1

S.No	Particulars	No of Units	Requested Load in KW	Total load in KW
1	4 BHK	113	4.5	508.5
2	3 BHK	826	3	2478
3	2BHK	14	2	28
4	Common Main-01	1	95	95
5	Common Main-02	1	95	95
6	Common Main-03	1	98	98
7	Common Main-04	1	97	97
Total Units and Total Load		957		3399.5

Parcel-3: Apartment: Building 2 & 3

S.No	Particulars	No of Units	Requested Load in KW	Total load in KW
1	1 BHK	849	1	849
2	2 BHK	1370	2	2740
3	Common Main-01	1	85	85
4	Common Main-02	1	85	85
5	Common Main-03	1	80	80
6	Common Main-04	1	85	85
Total Units and Total Load		2223		3924

Parcel-4: Apartment: Building 4

S.No	Particulars	No of Units	Requested Load in KW	Total load in KW
1	3 BHK	600	3	1800
2	2 BHK	122	2	244
3	Common Main-01	1	90	90
4	Common Main-02	1	95	95
Total Units and Total Load		724		2229

Parcel-5: Apartment: Building 5

S.No	Particulars	No of Units	Requested Load in KW	Total load in KW
1	3 BHK	1856	3	5568
2	2 BHK	0	0	0
3	Common Main	1	85	85
4	Common Main-02	1	80	80
5	Common Main-03	1	75	75
6	Common Main-04	1	75	75
Total Units and Total Load		1860		5883

Parcel-6: Apartment: Building 6

S.No	Particulars	No of Units	Requested Load in KW	Total load in KW
1	3 BHK	1104	3	3312
2	2 BHK	12	2	24
3	Common Main	1	97	97
4	Common Main-02	1	98	98
Total Units and Total Load		1118		3531
Grand Total No of Units and Load		7033		19980.5

4 This is for your kind information for further needful.


 Assistant Engineer (Elec)
 Sarjapura OBM
 Attibele Sub-Division


 Asst. Executive Engineer (Elec)
 BESCOM, Attibele Sub-Division,

ಅಯ್ಯಪ್ಪಾಚಾರ್ ಅಂಬೇಡ್ಕರ್ (ಎ)
 ಜಿ.ಎ.ಸಿ.ಕೆ. ಚಂದ್ರಾಕುರ ವಿಭಾಗ
 ಚಂದ್ರಾಕುರ

BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED.

Estimate No. AE/O & M/SJP:-

Date: 06.08.2021

Issue of NOC for Arranging Power Supply to Proposed Residential Layout to an extent 5690KW(6694KVA) in favour of M/s Prestige Projects Pvt Ltd at Sy. Nos. 6 (Part), 7/1, 7/2, 8, 9, 11/1, 11/2, 11/3, 11/4, 12/1, 16/2 (Part), 17/2, 17/4, 18 (Part) of Valagere, Kallahalli Village, 83/1, 83/2, 83/4, 83/5, 83/6, 83/7, 83/8, 83/12, 83/13, 83/14, 83/15, 83/16, 83/17, 83/18, 83/19, 84/1, 84/2, 84/3, 85/1, 85/2, 85/3, 85/4, 85/5, 86, 87/1, 87/2, 88/1, 88/2, 88/3, 89, 90/2, 91, 92, 93, 94, 95/1, 95/2, 95/3, 95/4, 96/2, of Ittangur Village, Sarjapur Hobli, Anekal Taluk, Bangalore District in Sarjapura O&M of Attibele Sub division (Under Self Execution Works).

Report :-

M/s Prestige Projects Pvt Ltd at Sy. Nos. 6 (Part), 7/1, 7/2, 8, 9, 11/1, 11/2, 11/3, 11/4, 12/1, 16/2 (Part), 17/2, 17/4, 18 (Part) of Valagere, Kallahalli Village, 83/1, 83/2, 83/4, 83/5, 83/6, 83/7, 83/8, 83/12, 83/13, 83/14, 83/15, 83/16, 83/17, 83/18, 83/19, 84/1, 84/2, 84/3, 85/1, 85/2, 85/3, 85/4, 85/5, 86, 87/1, 87/2, 88/1, 88/2, 88/3, 89, 90/2, 91, 92, 93, 94, 95/1, 95/2, 95/3, 95/4, 96/2, of Ittangur Village, Sarjapur Hobli, Anekal Taluk has requested to issue of NOC for Requested load of 5690KW(6694KVA) for Proposed Residential Layout. The Proposed Residential Layout Consists of 809 Sites with total layout Area of 80 Acres 31.5 Guntas.

Proposals:

The following Proposals are made under self execution to cater the required load.

- 1 For Regular Source, It is Proposed New Feeder by providing 11KV Switchgear in 66/11KV Dommasandra MUSS and Proposed to extend the 11KV line using 3*400 Sqmm XLPE HTUG Cable to a distance of 06 Kms by providing 06 Nos of Intermediate Compact OD's and Proposed to Provide 04 Way Compact RMU(20D+2VL) at the Proposed layout .
 - 2 For alternate Source , It is Proposed New Feeder by providing 11KV Switchgear in Proposed 66/11KV Prestige MUSS at Proposed Prestige Residential Apartment Premises and Proposed to extend the 11KV line using 3*400 Sqmm XLPE HTUG Cable to a distance of 02 Kms by providing 02 Nos of Intermediate Compact OD's .
 - 3 It is Proposed to Provide 17 x 250KVA Cable Entry Type 5 Star Rated Distribution Transformers in Proposed layout Under Self Execution Works.
 - 4 It is Certified that,
 - a. There is no IP sets existing in this Premises.
 - b. There is no long disconnected installation existing in this Premises.
 - c. There is no lake inside/near to this Premises.
 - d. There is no LT/HT/EHT lines crossing in this Premises.
 - e. Sufficient space is available in Applicant premises for erection of TC Centers, Metering Cubicle, RMU, Etc
- This is for your kind information for further needful.



Assistant Engineer (Elec)
Sarjapura O&M
Attibele Sub-Division


Asst. Executive Engineer (Elec)
BESCOM, Attibele Sub-Division,

BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

Issue of NOC for Arranging Power Supply to Proposed Residential Layout to an extent 5690KW(6694KVA) in favour of M/s Prestige Projects Pvt Ltd at Sy Nos Sy. Nos. 6 (Part), 7/1, 7/2, 8, 9, 11/1, 11/2, 11/3, 11/4, 12/1, 16/2 (Part), 17/2, 17/4, 18 (Part) of Valagere, Kallahalli Village, 83/1, 83/2, 83/4, 83/5, 83/6, 83/7, 83/8, 83/12, 83/13, 83/14, 83/15, 83/16, 83/17, 83/18, 83/19, 84/1, 84/2, 84/3, 85/1, 85/2, 85/3, 85/4, 85/5, 86, 87/1, 87/2, 88/1, 88/2, 88/3, 89, 90/2, 91, 92, 93, 94, 95/1, 95/2, 95/3, 95/4, 96/2, of Ittangur Village, Sarjapur Hobli, Anekal Taluk, Bangalore District in Sarjapura O&M of Attibele Sub division (Under Self Execution Works).

Sketch:

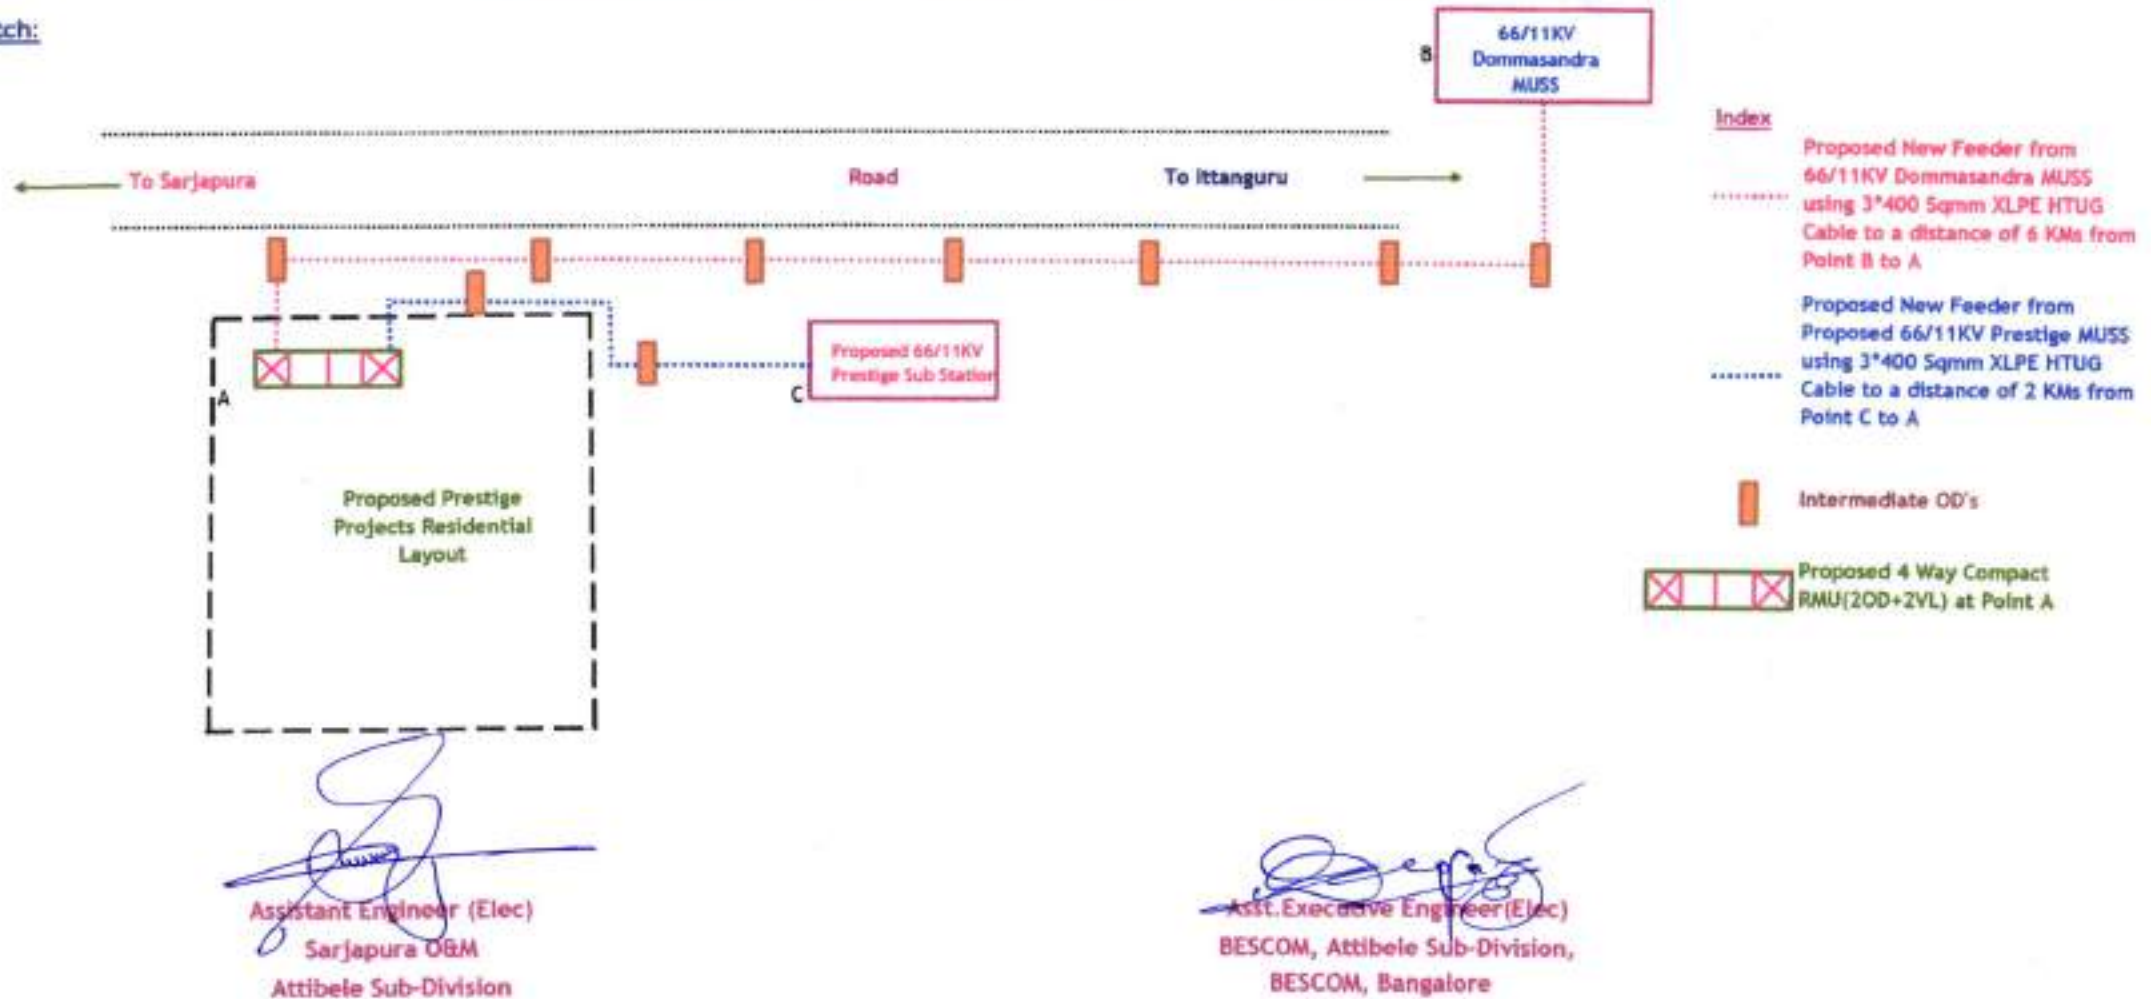


BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

Issue of NOC for Arranging Power Supply to Proposed Residential Layout to an extent 5690KW(6694KVA) in favour of M/s Prestige Projects Pvt Ltd at Sy. Nos. 6 (Part), 7/1, 7/2, 8, 9, 11/1, 11/2, 11/3, 11/4, 12/1, 16/2 (Part), 17/2, 17/4, 18 (Part) of Valagere, Kallahalli Village, 83/1, 83/2, 83/4, 83/5, 83/6, 83/7, 83/8, 83/12, 83/13, 83/14, 83/15, 83/16, 83/17, 83/18, 83/19, 84/1, 84/2, 84/3, 85/1, 85/2, 85/3, 85/4, 85/5, 86, 87/1, 87/2, 88/1, 88/2, 88/3, 89, 90/2, 91, 92, 93, 94, 95/1, 95/2, 95/3, 95/4, 96/2, of Ittangur Village, Sarjapur Hobli, Anekal Taluk, Bangalore District in Sarjapura O&M of Attibele Sub division (Under Self Execution Works).

Regular Source:

HT Voltage regulation of Proposed New Feeder Eminating from 66/11KV Dommasandra MUSS

After

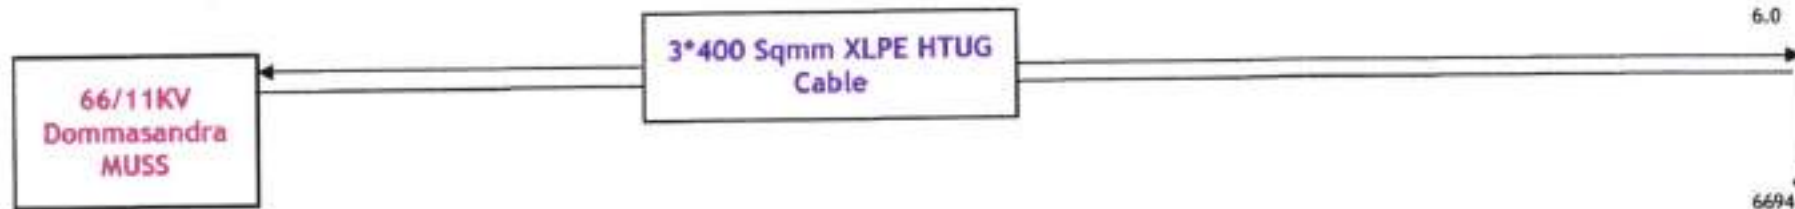

0	+	6694	=	6694	X	6.0	=	40164.00
								40164.00

HTVR =	KVA X KM X Const			40164.00	X	0.0041	164.6724
	DF X 100			1.5	X	100	150

$$\text{HTVR} = 1.098$$

Assistant Engineer (Elec)
Sarjapura O&M
Attibele Sub-Division

Asst. Executive Engineer (Elec)
BESCOM, Attibele Sub-Division,



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED


PROFORMA

Issue of NOC for Arranging Power Supply to Proposed Residential Layout to an extent 5690KW(6694KVA) in favour of M/s Prestige Projects Pvt Ltd at Sy. Nos. 6 (Part), 7/1, 7/2, 8, 9, 11/1, 11/2, 11/3, 11/4, 12/1, 16/2 (Part), 17/2, 17/4, 18 (Part) of Valagere, Kallahalli Village, 83/1, 83/2, 83/4, 83/5, 83/6, 83/7, 83/8, 83/12, 83/13, 83/14, 83/15, 83/16, 83/17, 83/18, 83/19, 84/1, 84/2, 84/3, 85/1, 85/2, 85/3, 85/4, 85/5, 86, 87/1, 87/2, 88/1, 88/2, 88/3, 89, 90/2, 91, 92, 93, 94, 95/1, 95/2, 95/3, 95/4, 96/2, of Ittangur Village, Sarjapur Hobli, Anekal Taluk, Bangalore District in Sarjapura O&M of Attibele Sub division (Under Self Execution Works).

Sl. No.	Particulars	Details				
1	Name & Address of the Applicant	M/s Prestige Projects Pvt Ltd				
2	Location of the Installation	Sy. Nos. 6 (Part), 7/1, 7/2, 8, 9, 11/1, 11/2, 11/3, 11/4, 12/1, 16/2 (Part), 17/2, 17/4, 18 (Part) of Valagere, Kallahalli Village, 83/1, 83/2, 83/4, 83/5, 83/6, 83/7, 83/8, 83/12, 83/13, 83/14, 83/15, 83/16, 83/17, 83/18, 83/19, 84/1, 84/2, 84/3, 85/1, 85/2, 85/3, 85/4, 85/5, 86, 87/1, 87/2, 88/1, 88/2, 88/3, 89, 90/2, 91, 92, 93, 94, 95/1, 95/2, 95/3, 95/4, 96/2, of Ittangur Village, Sarjapur Hobli, Anekal Taluk.				
3	Type(Nature of Activity)	Proposed Residential lay-out				
4	Date of Registration of the Application in Sub-Division Office					
5	Date of receipt of the proposal in Division office					
6	Date of receipt of the proposal in Circle office					
7	Date of receipt of the proposal in Zonal Office.					
8	Whether the firm has been issued with NOC? If yes, please furnish the details & enclose the same (copy)					
9	Requisitioned load details	5690KW(6694KVA)				
	a. Requisitioned Contract Demand/load	5690KW(6694KVA)				
	b. Voltage class	11 KV/433Volts				
	c. Tariff	LT2				
	d. Nature of the premises	Residential lay-out				
10	Regular Source Station details (Proposed)					
	Sub-Station Details					
	Name of the station	Voltage Class in KV	Installed Capacity in MVA	Peak Load of the station (In MWs)		
	Dommasandra MU55	66/11 KV	2X20 MVA	19.2 MWs		
11	Bank Details					
	Name of the Bank	Connected CT Ratio	Peak load of Bank(In MW)	Name of the Feeder	Connected CT Ratio	Peak Load in MW
	B-1	1200/1	11	F1 V kalihalli	200/1A	2.00
				F2-Dommasandra	400/1A	2.20
				F3-Agara	400/1A	0.60
				F4-Sarjapura	200/1A	0.00
				F5-Neriga(Agri)	400/1A	1.30
				F11-NJY	200/1A	2.30
				F12- Trinity	400/1A	1.40
				F13 -Ahad Builders	200/1A	1.50
				F-15 TC halli	200/1A	1.10
				F17 APG Homes	200/1A	0.60

	Name of the Bank	Connected CT Ratio	Peak load of Bank(In MW)	Name of the Feeder	Connected CT Ratio	Peak Load in MW	
12	B-2	1200/1	8.2	F6-Sarjapura	400/1A	2.20	
				F7 - Vakil layout	200/1A	0.20	
				F8- Stn Aux	200/1A		
				F9 -Chambenahalli	400/1A	2.30	
				F10 - Wipro	400/1A	2.40	
				F-14- Dommasandra	200/1A	0.20	
				F-16 Wipro SEZ project	400/1A	1.50	
13	Name of the Feeder on which the proposed load is to be catered	Proposed Peak load of the feeder (in MW)	Size of the Conductor/ Cable	Length of the feeder in Km	HTVR of the feeder before adding the proposed load	HTVR of the feeder after adding the proposed load	Connected /Available CT Ratio
	New Feeder	5.6 MW	3*400 Sqmm HTUG Cable	6		1.10%	400/1A

Certificate: 1.Certified that there is no IP-set installation inside this Layout.2.Certified that there is no arrears outstanding inside the Layout.3. This layout does not comes near lake/Pond. 4.This is an Independent Layout. 5.Certified that there is no EHT/HT/LT line passing inside this Layout.

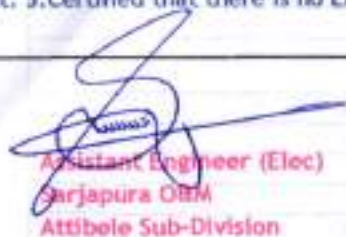
 Assistant Engineer (Elec)
 Sarjapura OBM
 Attibole Sub-Division


 Asst. Executive Engineer (Elec)
 BESCOM, Attibole Sub-Division,

Sl. No.	Name of the Feeder	Proposed Peak load of the feeder (in MW)	Size of the Conductor/ Cable	Length of the feeder in Km	HTVR of the feeder before adding the proposed load	HTVR of the feeder after adding the proposed load	Connected /Available CT Ratio
1	F6-Sarjapura	2.20	3*400 Sqmm HTUG Cable	6		1.10%	400/1A
2	F7 - Vakil layout	0.20					
3	F8- Stn Aux						
4	F9 -Chambenahalli	2.30					
5	F10 - Wipro	2.40					
6	F-14- Dommasandra	0.20					
7	F-16 Wipro SEZ project	1.50					
8							
9							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							
32							
33							
34							
35							
36							
37							
38							
39							
40							
41							
42							
43							
44							
45							
46							
47							
48							
49							
50							
51							
52							
53							
54							
55							
56							
57							
58							
59							
60							
61							
62							
63							
64							
65							
66							
67							
68							
69							
70							
71							
72							
73							
74							
75							
76							
77							
78							
79							
80							
81							
82							
83							
84							
85							
86							
87							
88							
89							
90							
91							
92							
93							
94							
95							
96							
97							
98							
99							
100							