
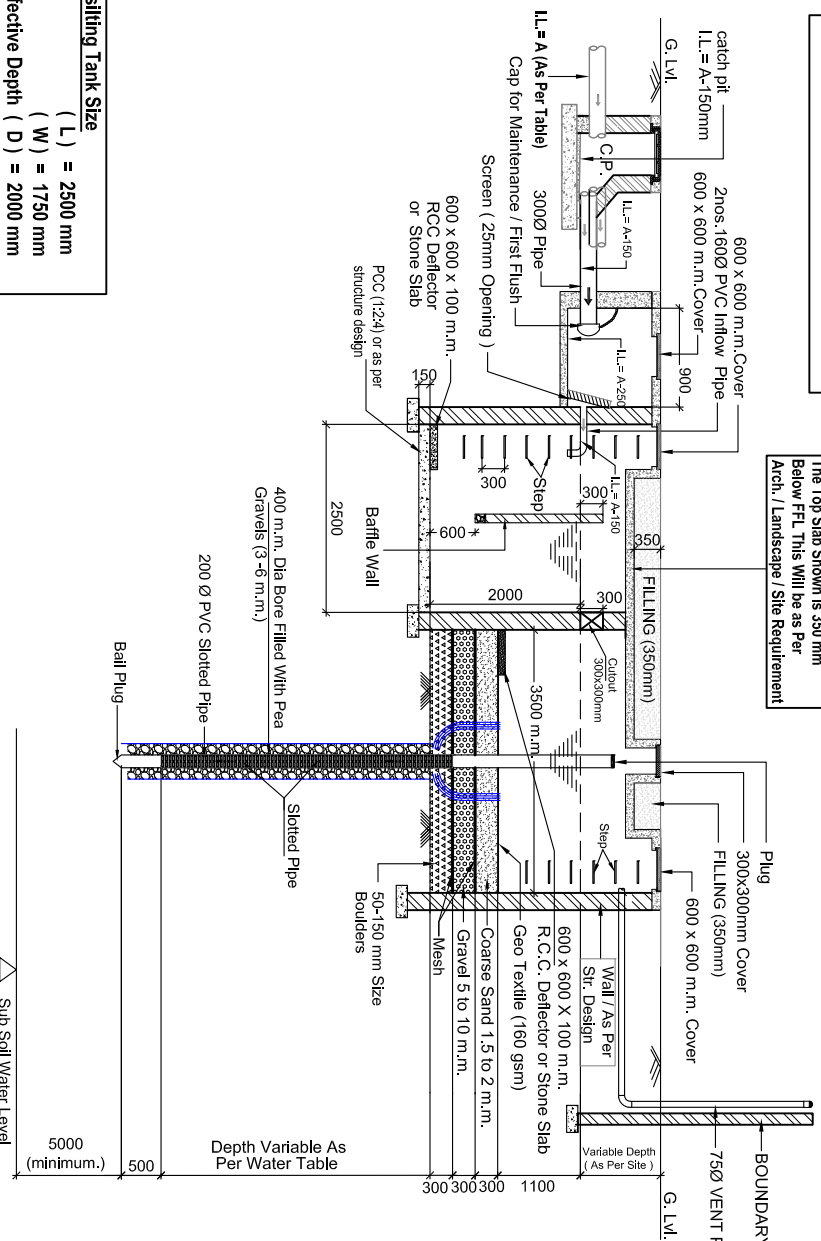
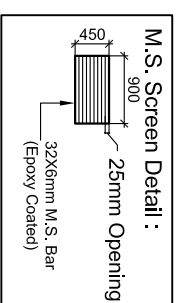
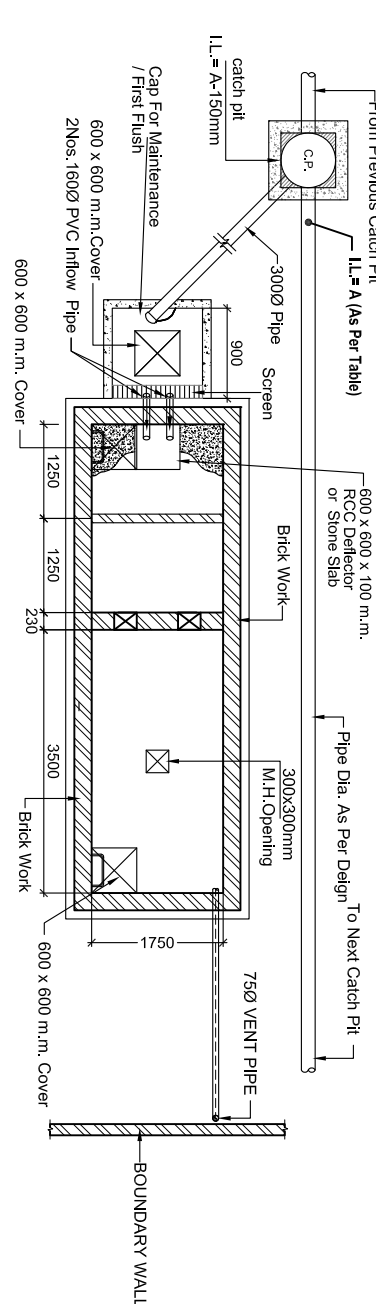


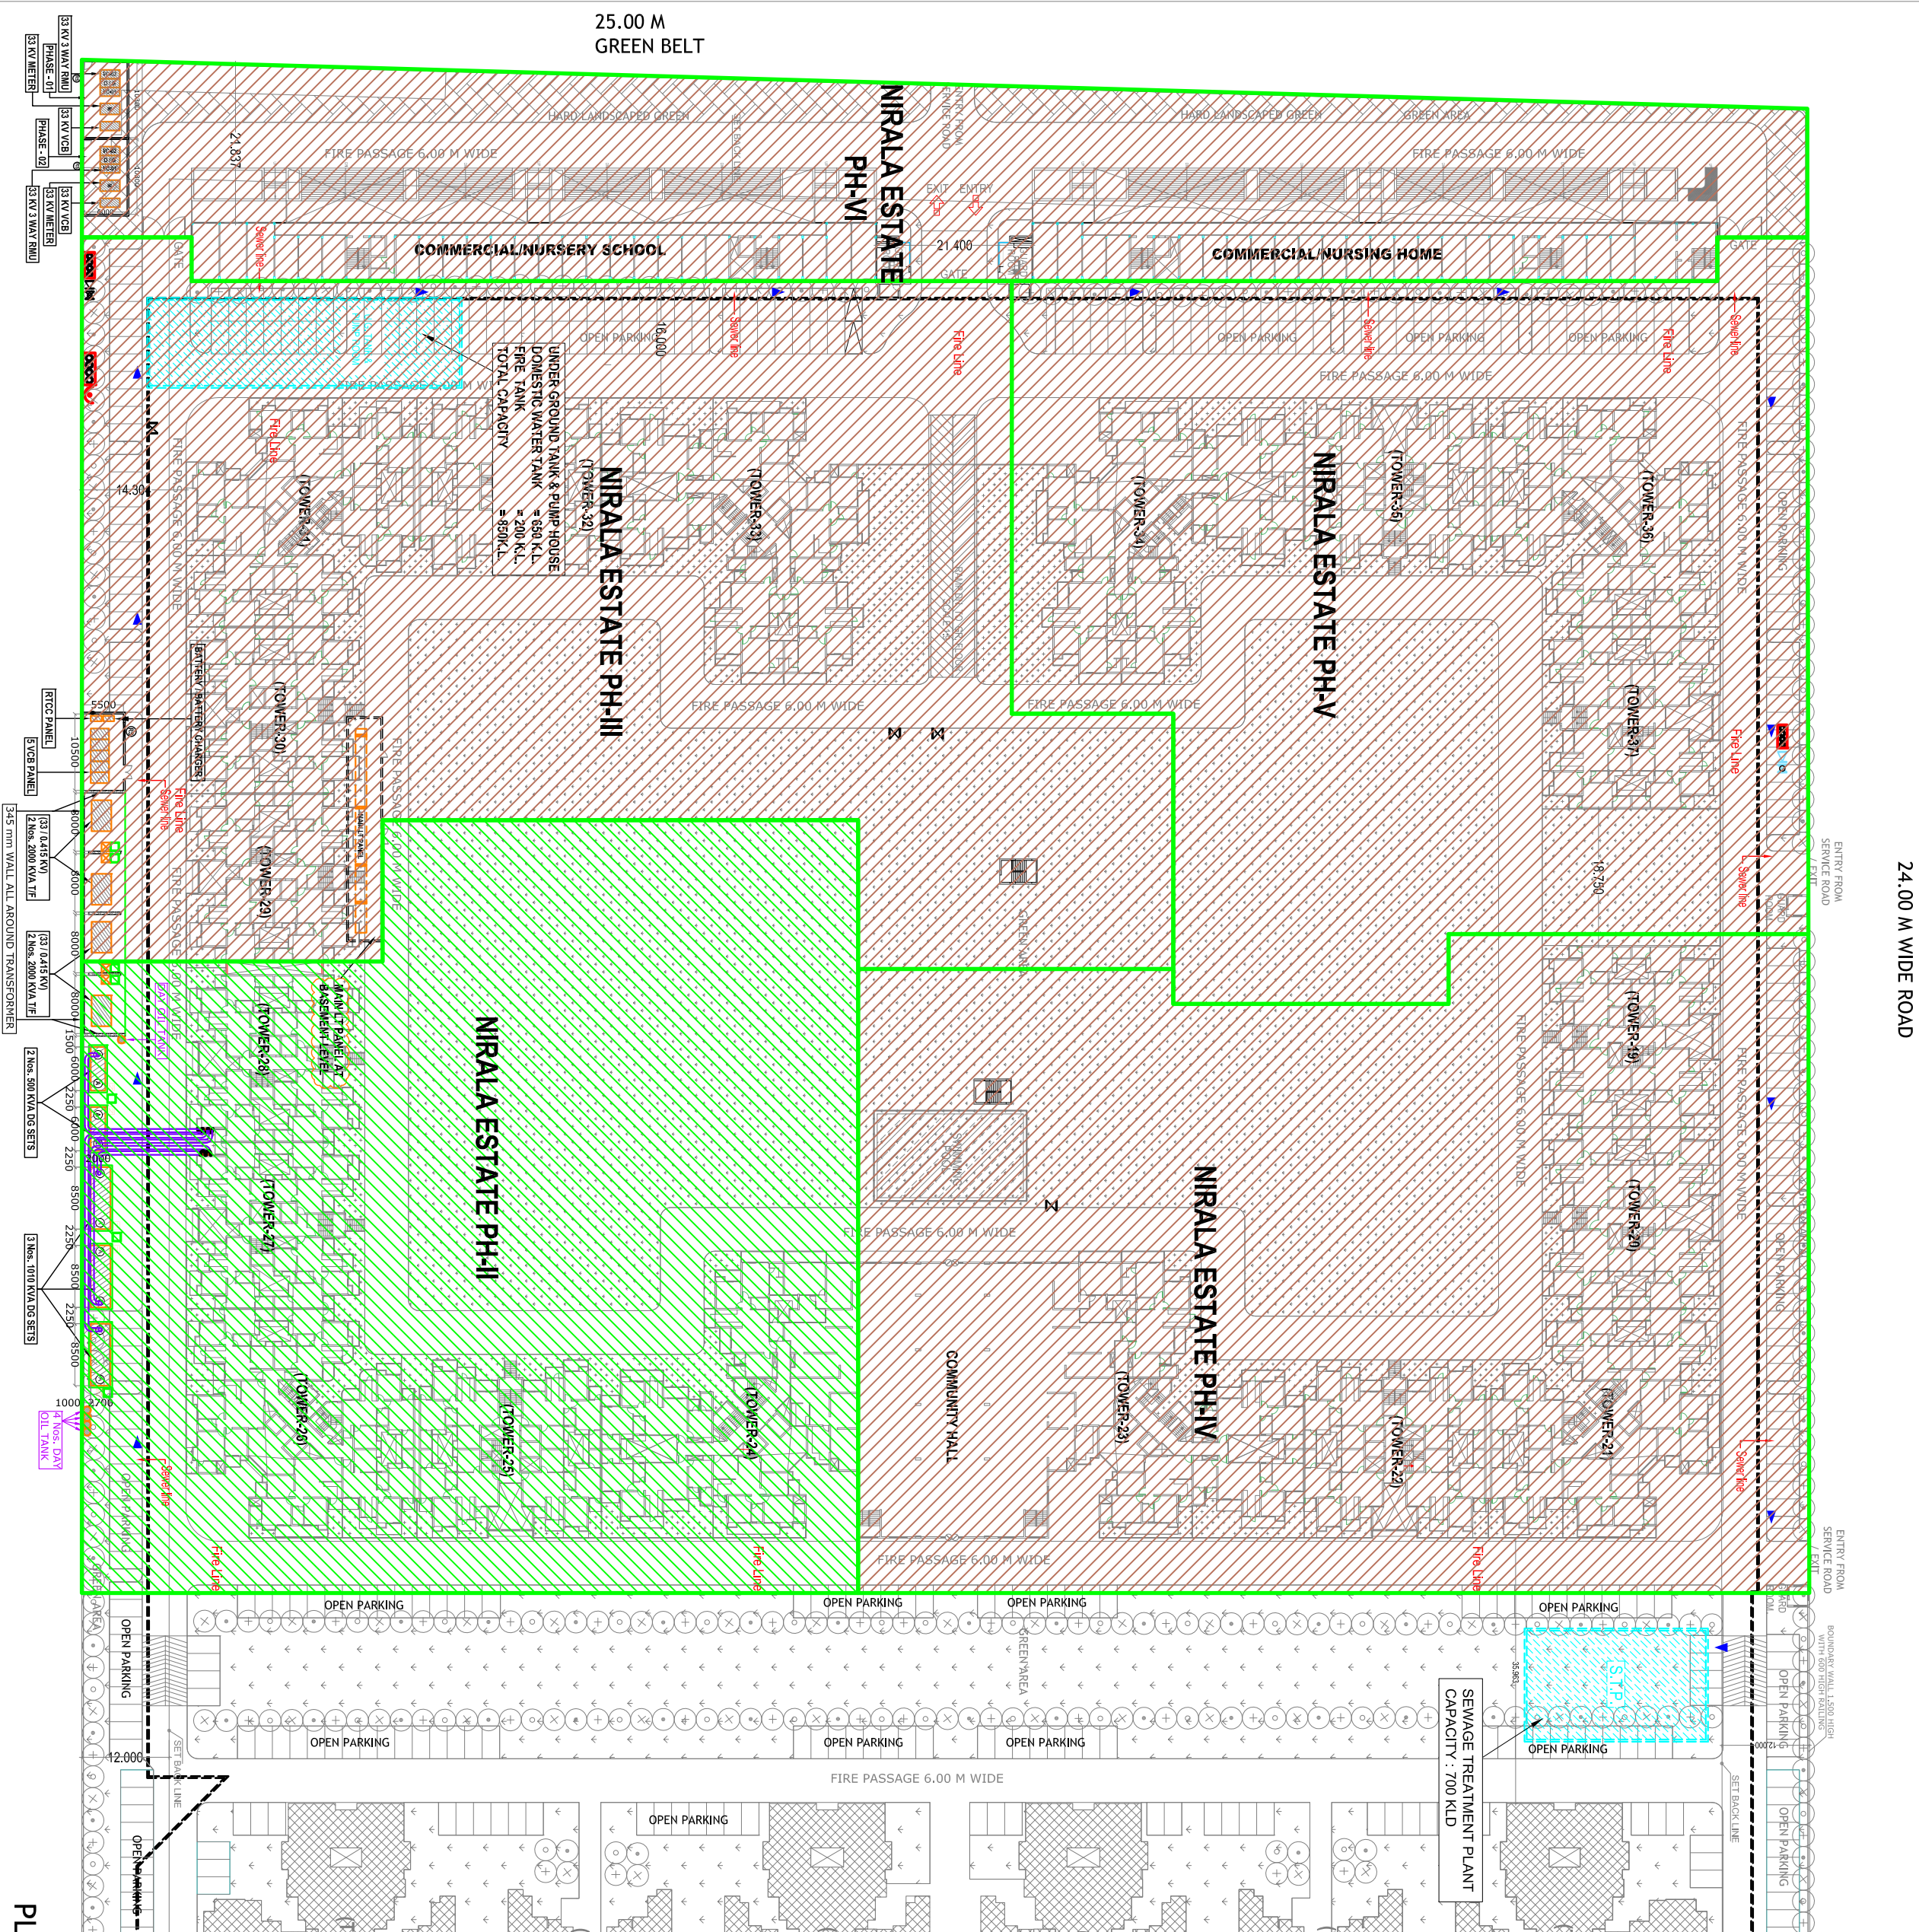

Destilling Tank Size (L) = 2500 mm (W) = 1750 mm Effective Depth (D) = 2000 mm	Recharge Pit Size (L) = 3500 mm (W) = 1750 mm Effective Depth (D) = 2000 mm
--	---

Section
RWH Detail
Total Number of RWH = 14

LEGEND :		
S. No.	SYMBOL	DESCRIPTION
1.	M.H.	MANHOLE
2.		SEWER LINE
3.	C.P.	CATCH PIT
4.		UNDERGROUND PIPE DRUN
5.		DOMESTIC WATER SUPPLY LINE
6.		MUNICIPAL WATER SUPPLY PIPE LINE
7.		SEWER TO WATER SUPPLY LINE FOR FLUSHING & PORTOULINDE
8.		PROPOSED TIE IN WELL
9.	OH	GASCHER HYDROPIST
10.		BASEMENT RETAINING WALL
11.		
12.		RAIN WATER HARVESTING

LEGEND : FIRE SYSTEM		
S. No.	SYMBOL	DESCRIPTION
1.		FIRE LINE
2.		WATER MAIN VALVE WITH 200S, 15' LONG 3" VAL. OR, THE HOSE PIPE 3" OR BRANCH PIPE WITH NOZZLE
3.		4 WAY FIRE SPRINKLER CONNECTION
4.		BUTTERY VALVE
5.		NON-RETURN VALVE (CHECK VALVE)
6.		MASONRY CHAMBER FOR EXISTING VALVE

rev. no.	date	revision
--	--	--

project
NIRALA ESTATE AT GREATER NOIDA
PLOT NO. GH-04, TECHZONE - IV
GREATER NOIDA, UP
FOR - M/S NIRALA INFRA TECH PVT. LTD

LAYOUT PLAN (PHASE - II TO VI)

ELECTRICAL SETTING LAYOUT PLAN

drawing released for

☐ APPROVAL ☒ RERA SUBMISSION

☐ ADVANCE COPY ☐ CONSTRUCTION

scale	designed by
NIRALA / SUBMISSION / P/03	Baldev

date **October 2018** checked by **Anand Havelia**

DEEPAK MENIJA & ASSOCIATES
ARCHITECTS, PLANNERS, VALUERS, LANDSCAPE & INTERIORS

E-mail : deepakmenta1962@gmail.com, Website : www.indianarchitect.co.in

Consummate Engineering Services (P) Ltd.

Noida Office - B - 67, Sector - 67, Noida - 201 301
Tel : (0120) 2303500 / 30 (Lines)
(0120) 2303501
Lko. Office : R 006, Rohas Purnima, Gomti Nagar, Lucknow
e mail : mail@cespln, website : www.cespln