
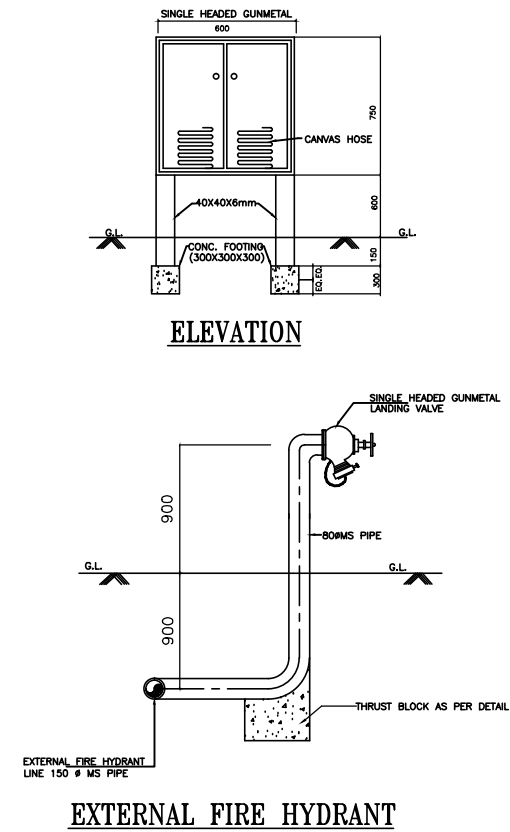


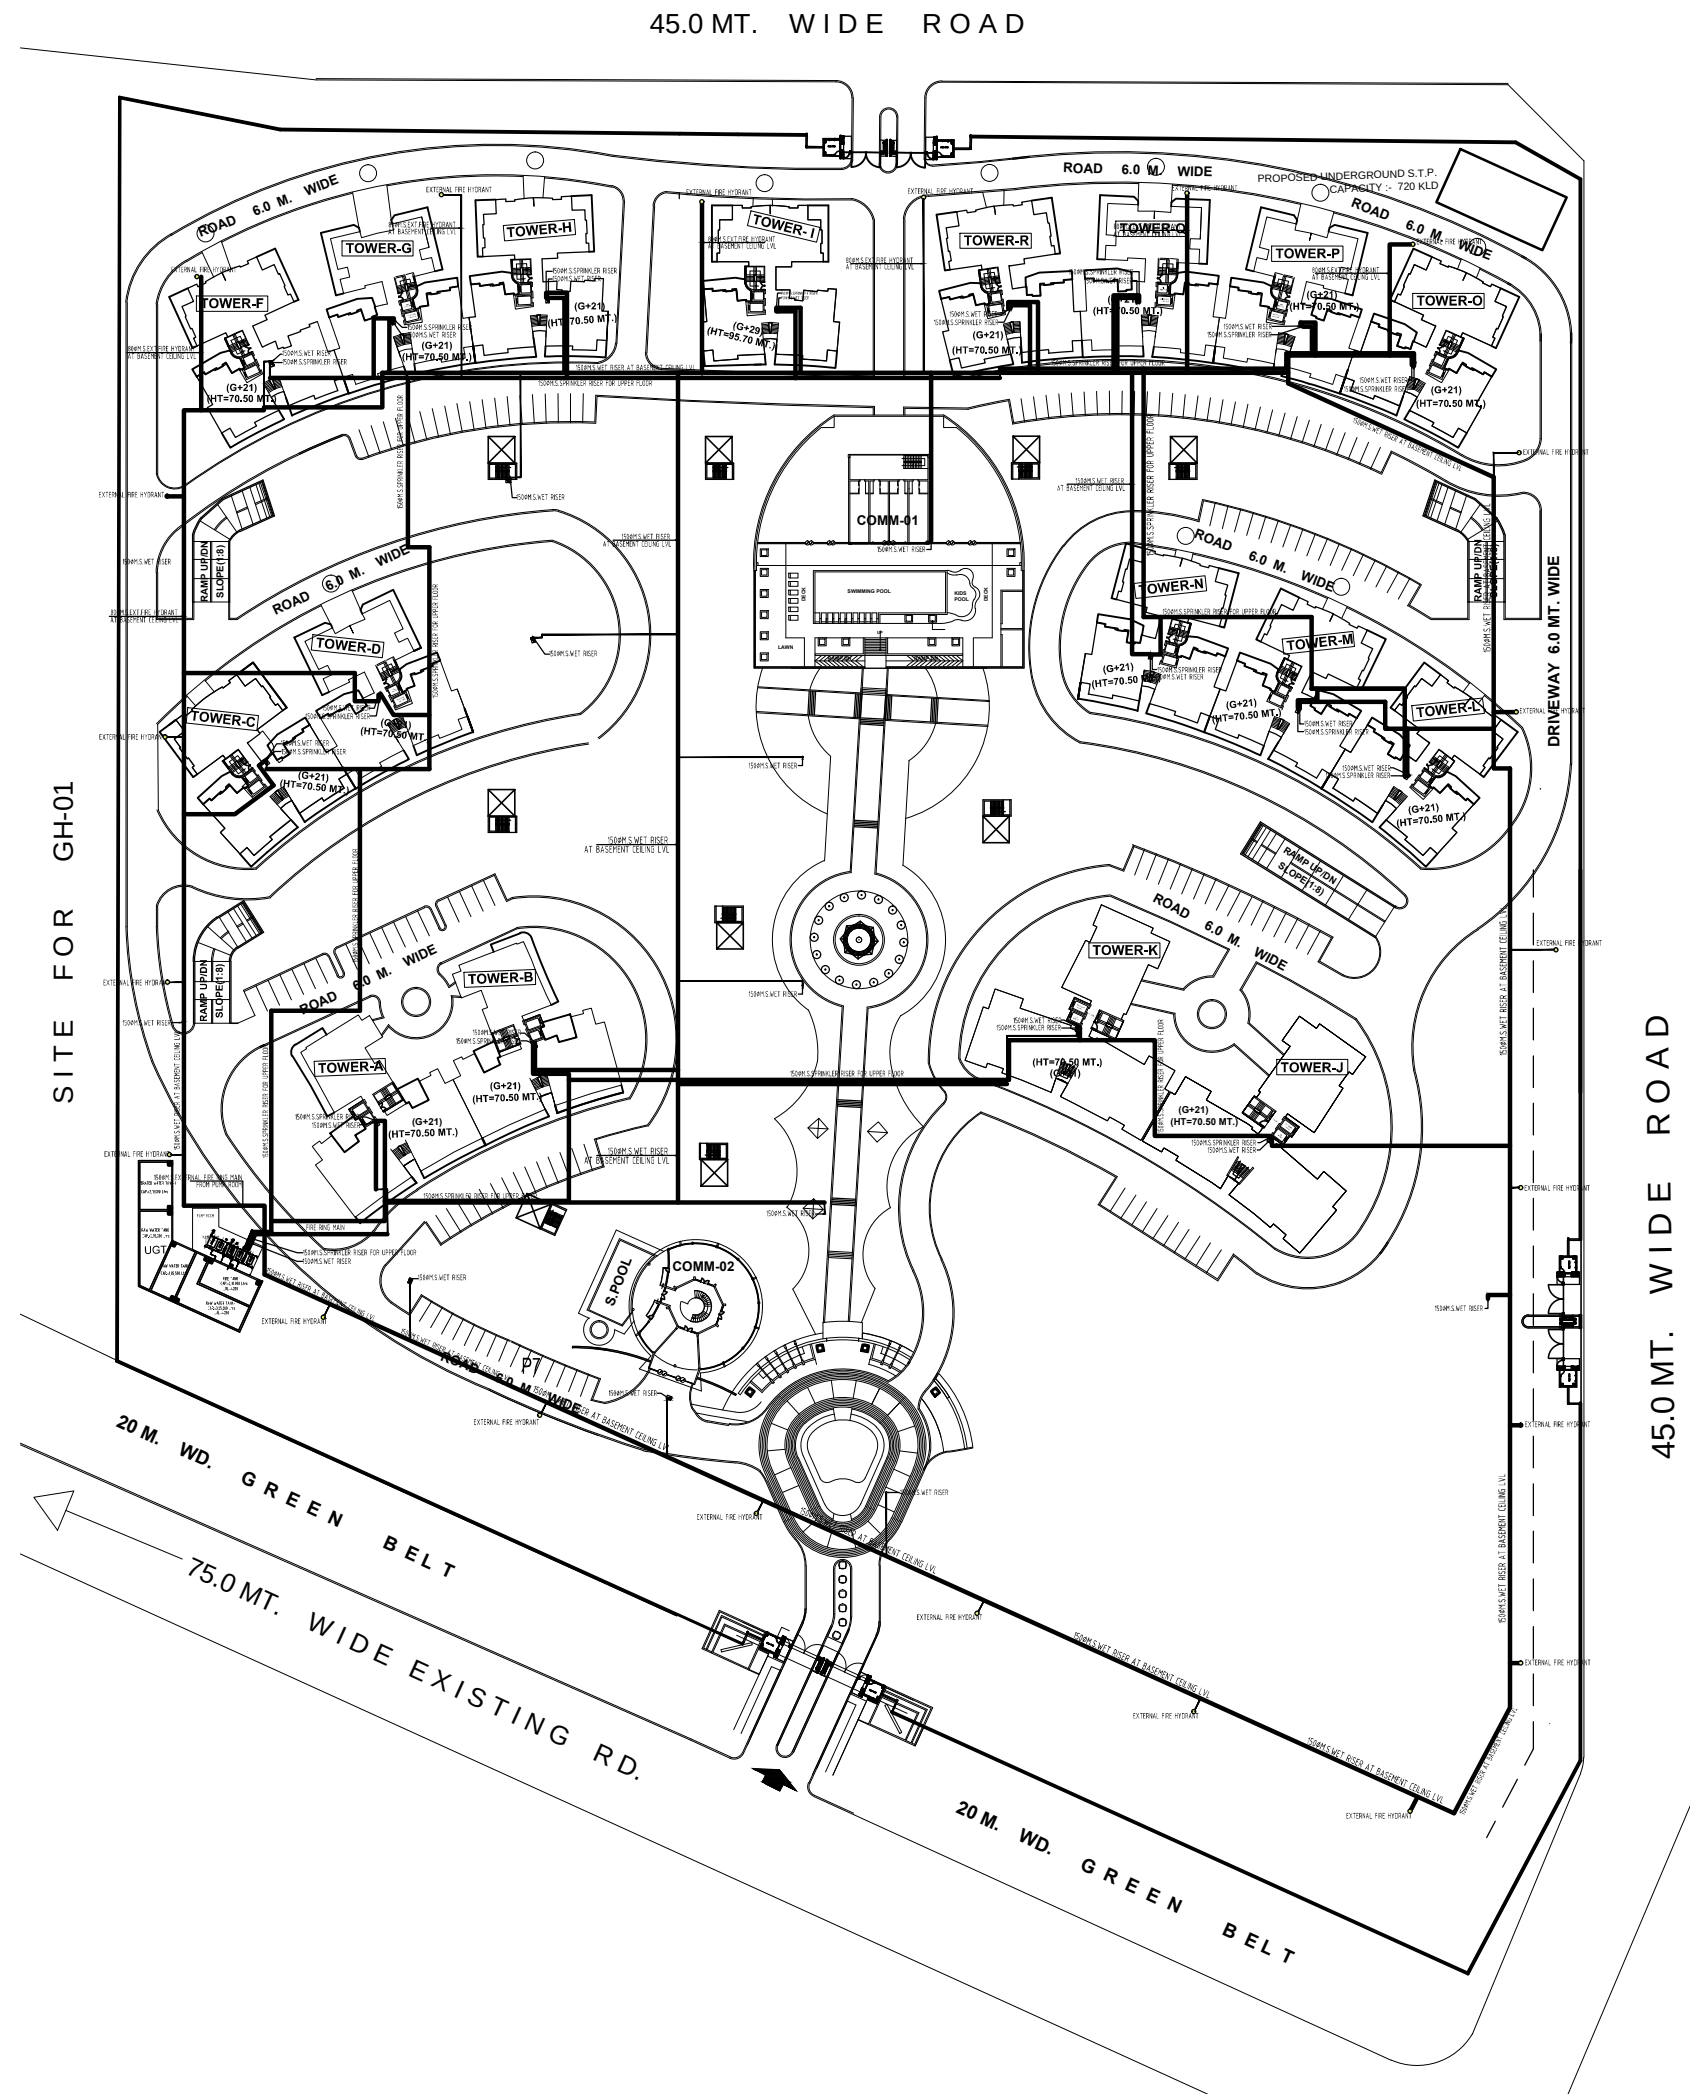

- FIRE FIGHTING NOTES**
- NOTE :- AS PER NATIONAL BUILDING CODE OF INDIA PART-4, FIRE AND LIFE SAFETY REVERED NOV.-2006 APARTMENT(A-4) BUILDING HEIGHT ABOVE 60M IN HEIGHTS
1. FIRE EXTINGUISHER
4.5 kg CO2
8kg ABC TYPE DRY POWDER
 2. HOSE REEL
 3. WET RISER
 4. YARD HYDRANT
 5. MANUALLY OPERATED ELECTRIC FIRE ALARM SYSTEMS
 6. AUTOMATIC DETECTION AND ALARM SYSTEM
 7. AUTOMATIC SPRINKLER SYSTEM ALL FLOORS(AS+UPPER FL)
 8. OVER HEAD FIRE TANK CAP.= 25,000Ltrs
 9. UNDERGROUND STATIC WATER STORAGE TANK CAP.= 1,50,000Ltrs
 10. P-1. MAIN FIRE PUMP
CAP.=3800Lpm
HEAD=140M
P-2. SPRINKLER PUMP
CAP.=2880Lpm
HEAD=140M
P-3. WET RISE PUMP
CAP.=3800Lpm
HEAD=140M
P-4. BOOSTER PUMP
CAP.=1800Lpm
HEAD=140M

LEGEND	
SYMBOL	DESCRIPTION
	BUTTER FLY VALVE
	NON RETURN VALVE
	FIRE HOSE CABINET WITH LANDING VALVE
	HOSE REEL, ZINC HOSE PIPE & BRANCH PIPE
	PENDANT TYPE SPRINKLER
	SIDE WALL TYPE SPRINKLER
	9 KG CAPACITY WATER CO2 TYPE FIRE EXTINGUISHER
	45 KG CAPACITY CO2 TYPE FIRE EXTINGUISHER
	MANUAL CALL BOX
	ROOFER
	FIRE ALARM PANEL CONTROL PANEL
	TWO WAY FIRE BRIGADE INLET CONNECTION
	FOUR WAY FIRE BRIGADE INLET CONNECTION

01	AT SITE BY MAIL	12/07/2017
No.	Revision/Issue	Date

TITLE:
PLUMBING DRAWING
EXTERNAL FIRE FIGHTING LAYOUT

PROJECT:
PROPOSED
GROUP HOUSING AT SEC-107,NOIDA

ARCHITECTS:
SPACE COMBINE
Architects,Engineers,Planners
project management consult.
A1/112 SAFDARJUNG ENCLAVE,
NEW DELHI -110029

Dealt :-	JOB NO.
Scale :- 1:425	
Dealt :- SUMIT	
Checked :- RAWAT	
Drg.No.:-SC/SH/PL/W/S/01	