
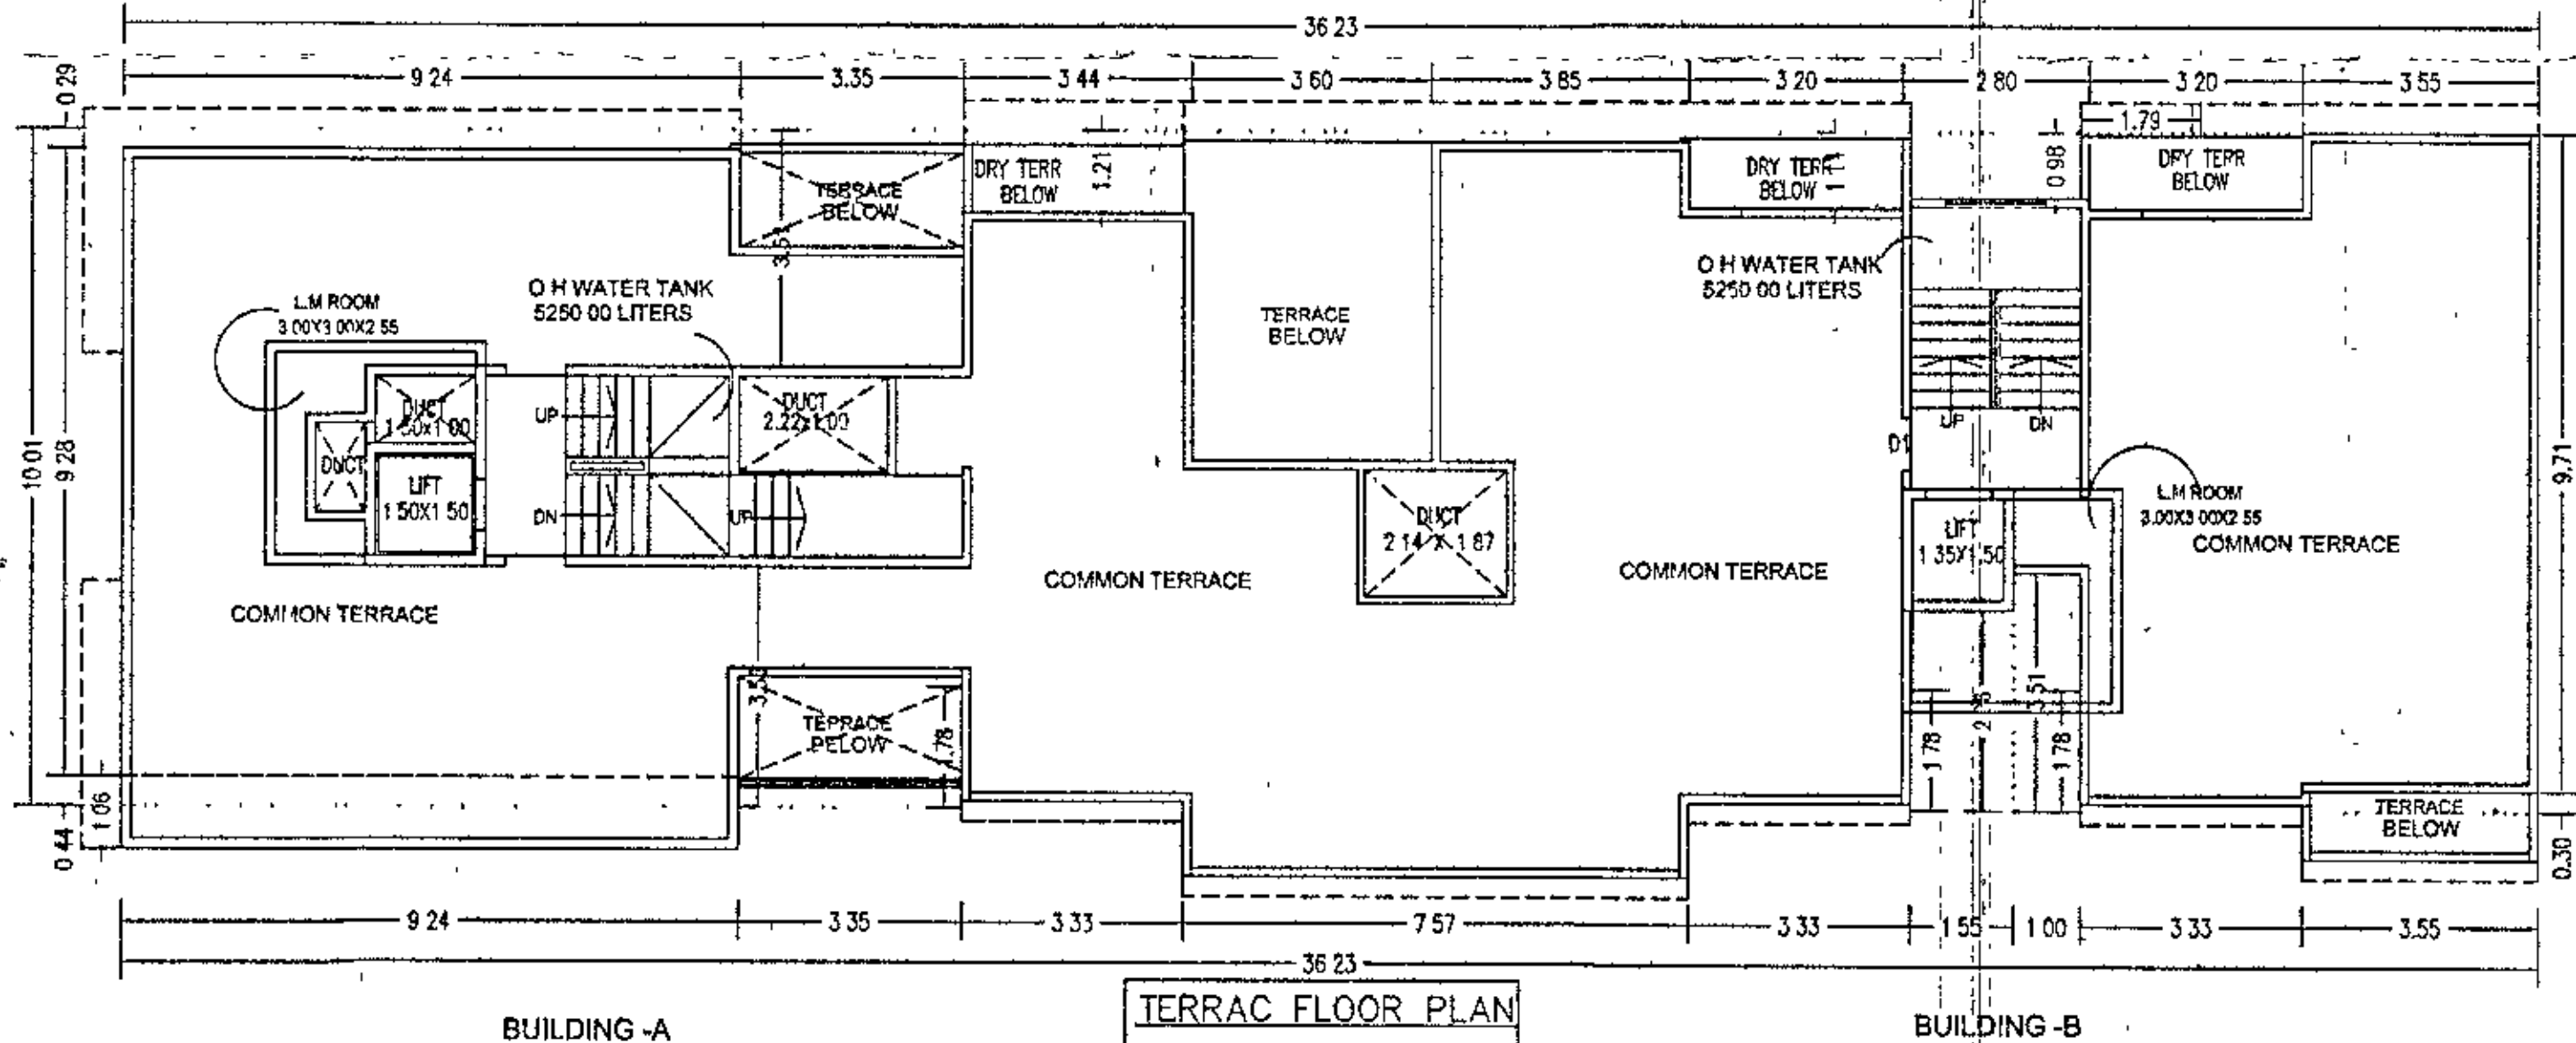
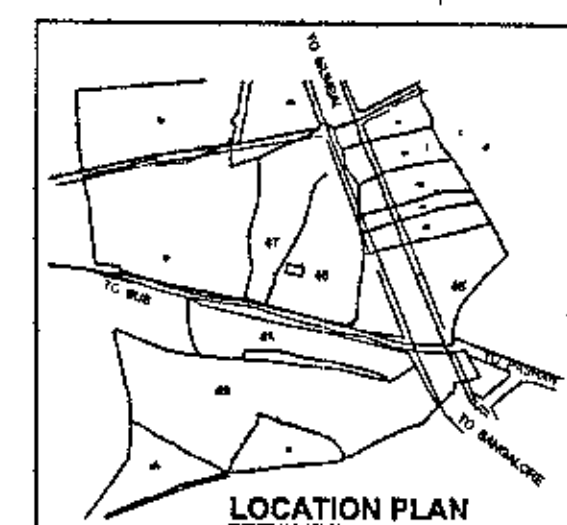
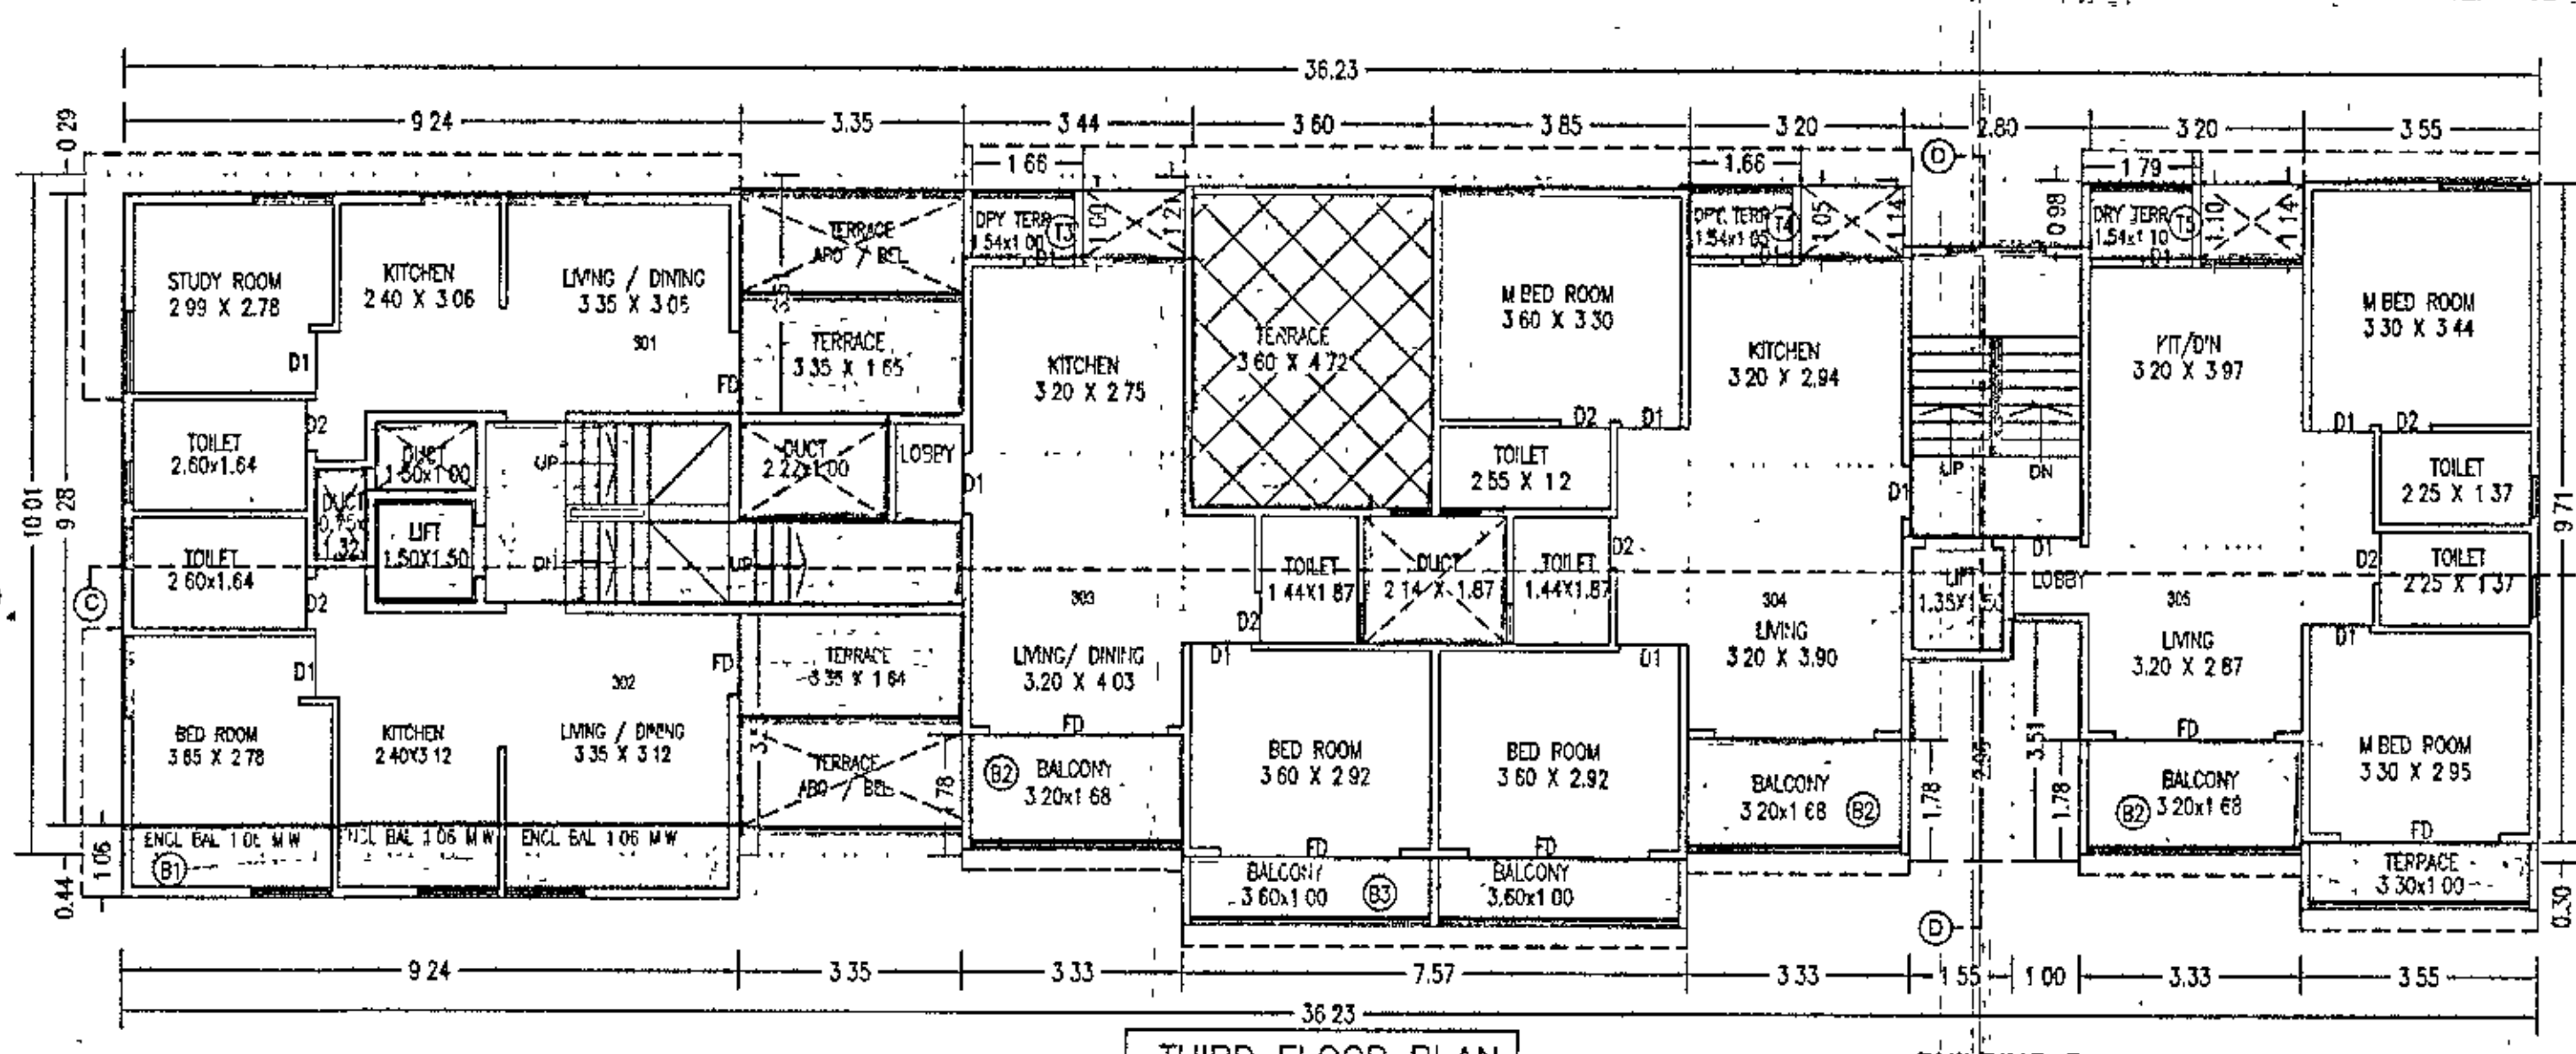
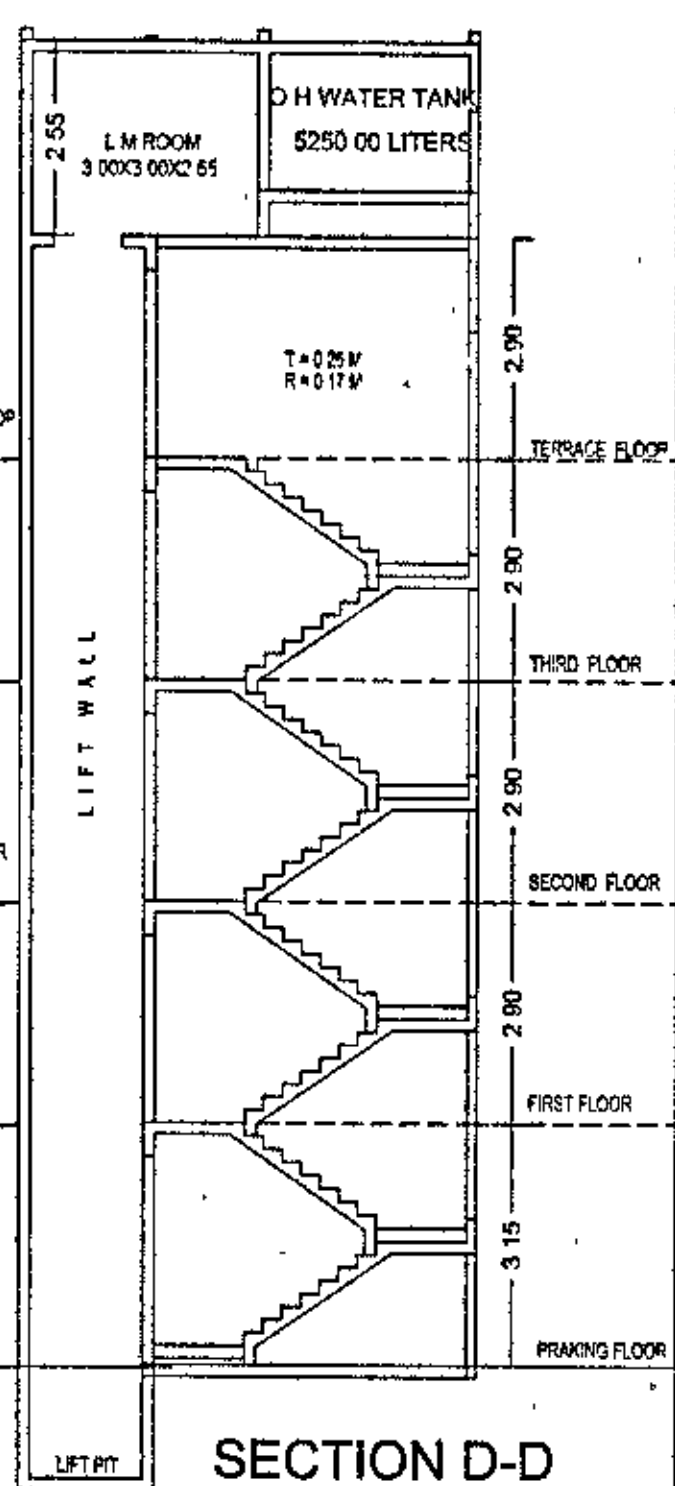


WATER STORAGE TANK CAP.
WATER REQ IN O/H. WATER TANK CAP.
5 TENA X 135 LIT X 50 = 40500 LITRES
SAY = 5000 00 LIT/day
O/H WATER TANK = 5000 00 Ltr.X1 50
U/G WATER TANK = 7500 00 LITRES

Building Inspector ~~Deputy Engineer~~
Building Development Department
Zone No. PM C

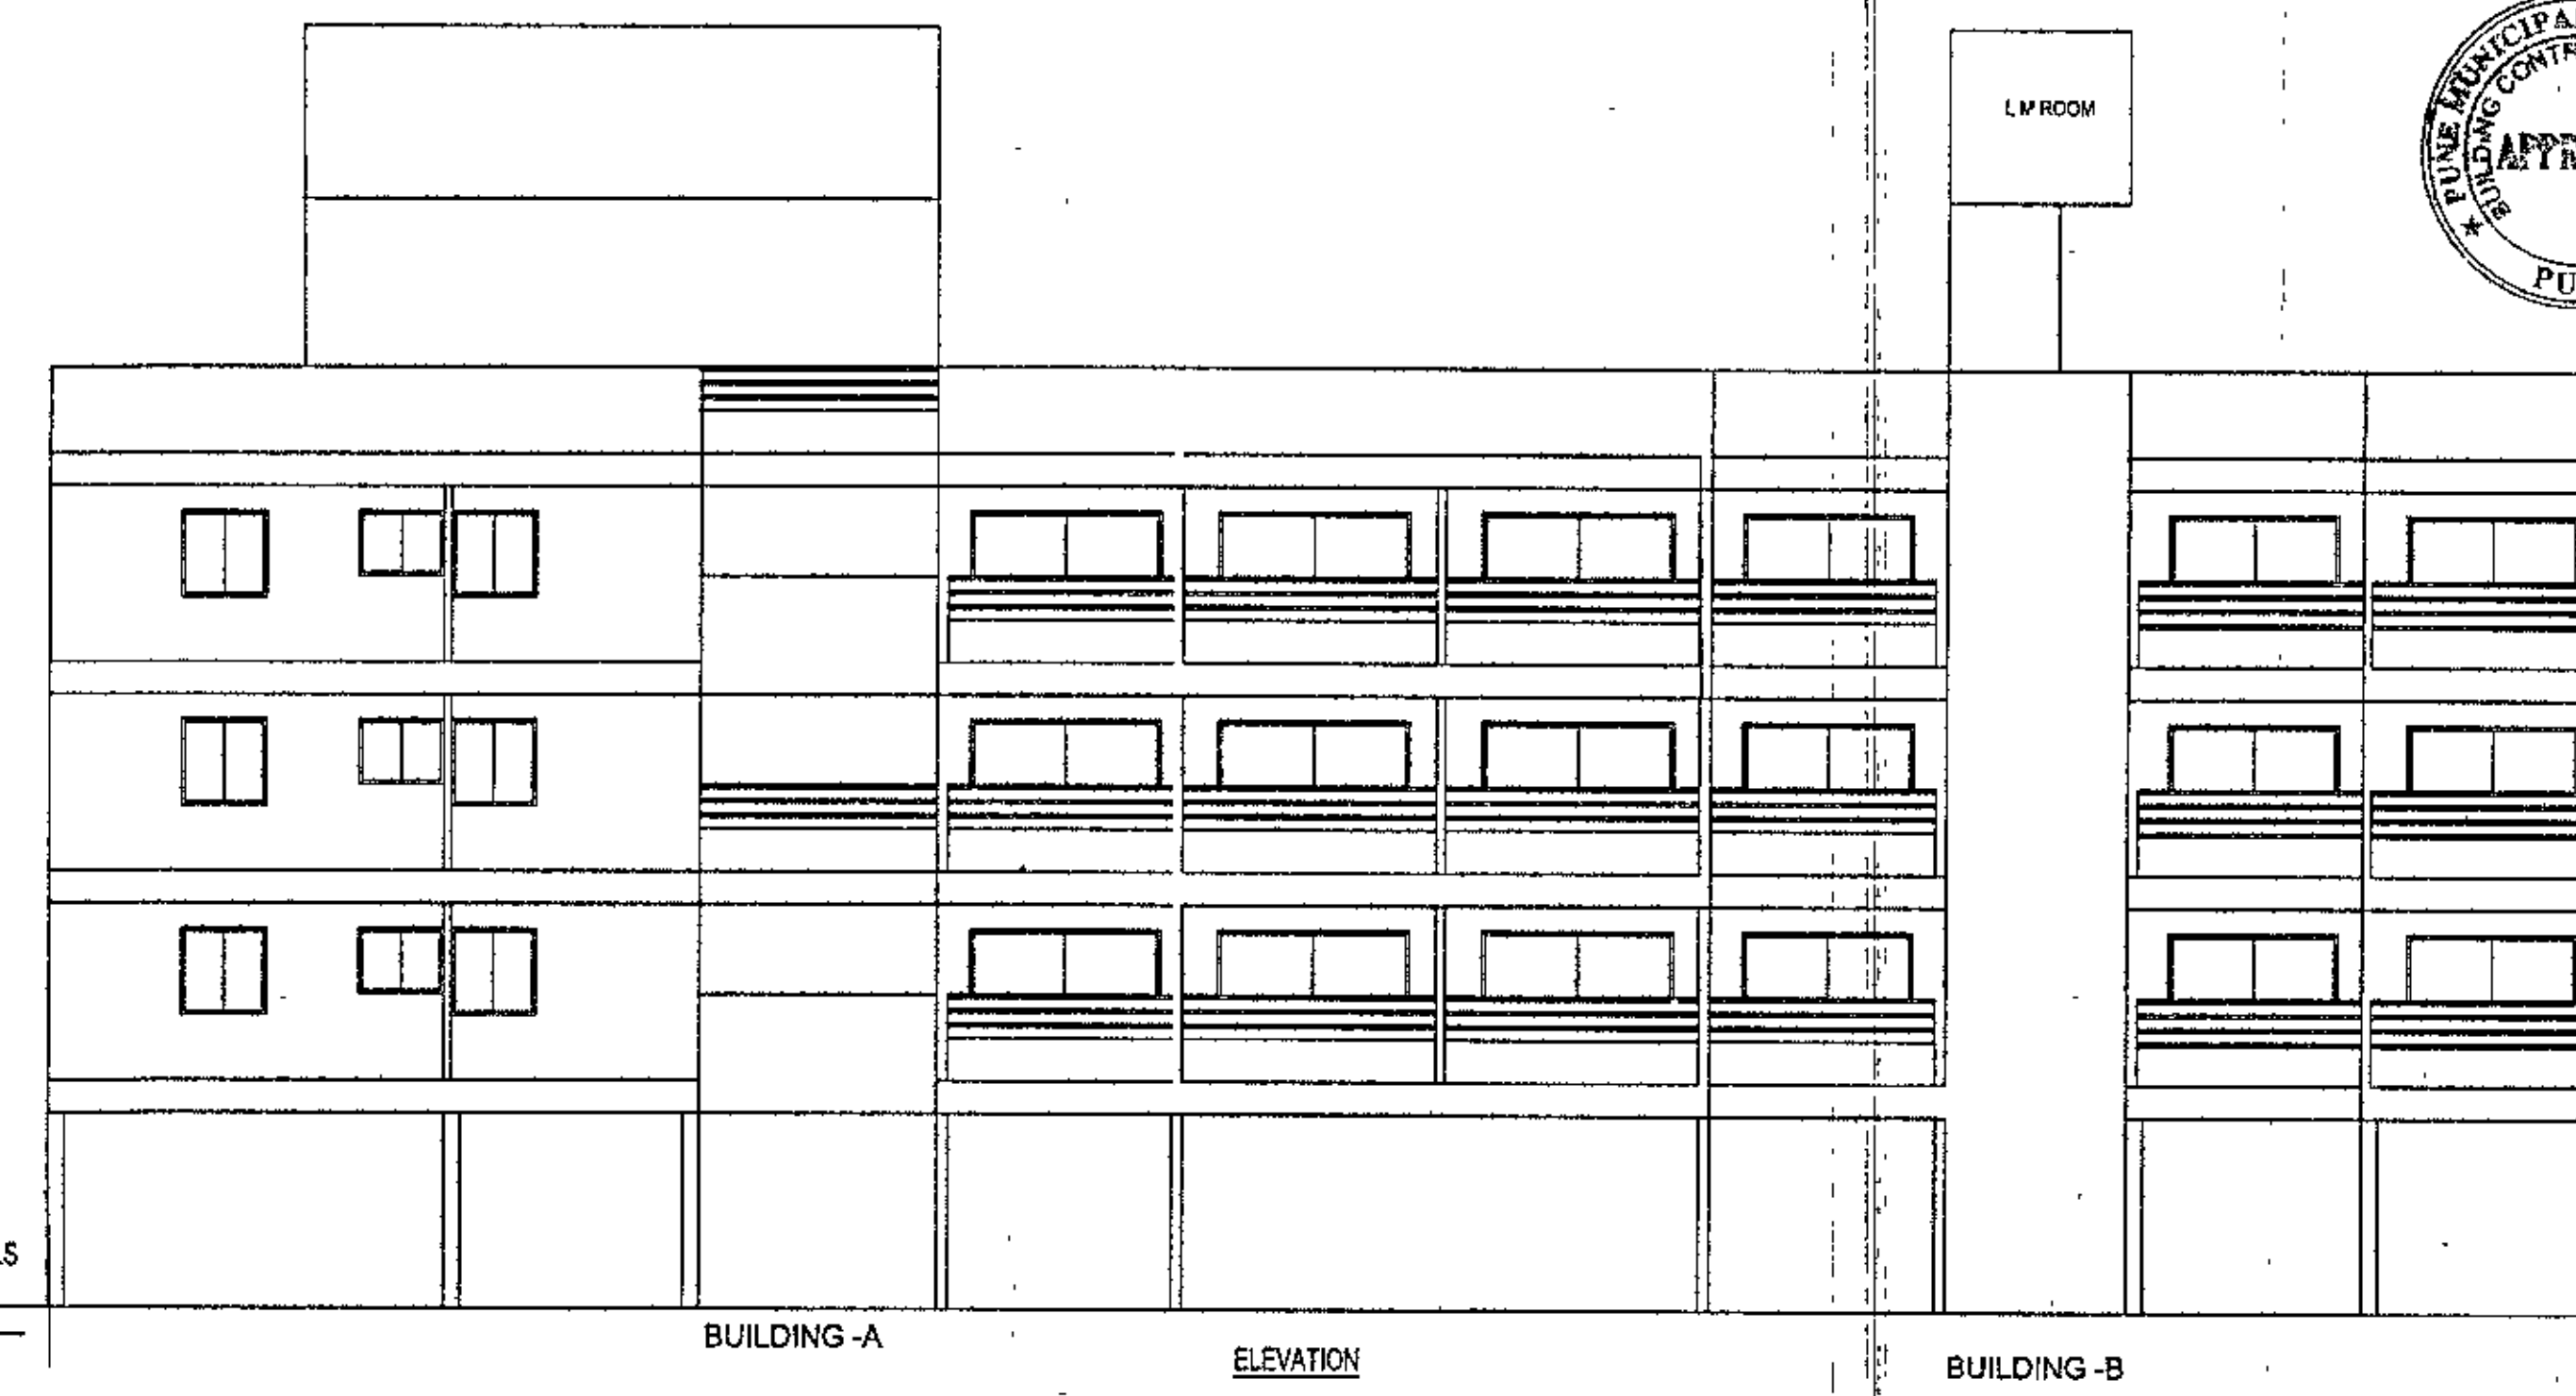

477, KASBA PETH, OPP. POST OFFICE.