



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

No. EEE/CDP/ AEE (O)/AE (T)/2023-24/ **7660-61**
E-mail Id: eechndpr.work@gmail.com
eeChandapuradivision@bescom.co.in
Mob. Ph. No. 9448279027

Office of the
Executive Engineer Elec;
C, O&M Division, BESCOM,
No. 204, Park Road,
Suryacity Phase-1, Chandapura
Date:

19 OCT 2023

To,
Sri. Rajamma & Others,
GPA M/s VRL Constructions,
Sy. No. 75/1 & 75/5,
Ittanguru Village,
Anekal Taluk.

Sir,

Sub:- Issue of NOC to your proposed to residential apartment of Sri. Rajamma & Others GPA M/s VRL Constructions at Sy. No. 75/1 & 75/5 at Ittanguru Village, Attibele Sub-Division.

Ref: 1) Your letter dated 13.10.2023
2) AEE/ATB/AE(T)/5404 dated 18.10.2023

<<<>>>

With reference to the above, "No Objection Certificate" from BESCOM side is hereby issued for your proposed residential apartment of Sri. Rajamma & Others GPA M/s VRL Constructions at Sy. No. 75/1 & 75/5 at Ittanguru Village, **Attibele Sub-Division**

1. The power supply to your proposed Residential apartment for power requirement of **150 Kws** will be arranged from F-01 Feeder of 66/11 KV Dommasandra MUSS it is proposed provide 11 Mtrs spun pole and to extend the 11 KV line to a distance of 100 Mtrs as shown in the sketch. It is also proposed provide LBS and 1*250 KVA 5 star rated cable entry type Transformer as shown in the sketch under Self Execution Scheme.
2. If any Existing HT line which is passing through your premises is to be shifted at your own cost before availing power supply. Sufficient horizontal clearance (Corridor) shall be maintained from the existing EHT lines, and there shall not be any construction underneath the existing EHT lines if any.
3. If any Existing LT line which is passing through your premises is to be shifted at your own cost before availing power supply. Sufficient horizontal clearance (Corridor) shall be maintained from the existing EHT lines, and there shall not be any construction underneath the existing EHT lines if any.
4. While applying for power supply to your proposed Residential apartment all formalities as per KERC Electricity Supply and Distribution Code 2004 shall be observed.
5. Power supply will be arranged to the proposed Residential apartment that may come up in the above premises as per provision or regulations in BESCOM. Prevailing at that time.
6. If any existing installation in your premises should be surrendered by clearing all the arrears, before taking up infrastructure work in the premises.
7. NOC is issued only for the purpose of obtaining sanction for the plan of proposed Residential apartment from the BDA/BMRDA/CMC/Competent authority and it is not a commitment for power sanction from BESCOM. Power supply will be sanctioned when applied for, subject to the feasibility prevailing at that time.
8. The approximate load requirement for the above proposed Residential apartment is of **150 Kws.**
9. The applicant has paid necessary Service Charges Rs. 5000/- Rt. No. 20230021296, CGST Rs. 450/- Vide RT No. 20230021297 and SGST Rs. 450/- Vide RT No. 20230021298 dated 18.10.2023.
10. BESCOM will not be held responsible for any liability arising from the issue of NOC.
11. This NOC is valid for a period of TWO (2) year from the date of issue of this letter.
12. Land to an extent of 16 mtr X 5 mtr open to sky at the entrance shall be marked in the sanctioned plan for installation of required electrical infrastructure.

Yours Sincerely,

Executive Engineer (Elec),
C, O&M Division, Chandapura
Executive Engineer(Elec)
BESCOM., O & M Divn
Chandapura, Bangalore-560 099



ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ಕಂಪನಿ ನಿಯಮಿತ
BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED
PROFORMA

Arranging power supply to New Installation/Issuing NOC for M/s Rajamma & Others GPA VRL Construction at Sy No 75/1 & 75/5 Ittangur village to an extent of 150 Kva in Ittangur village in Sarjapura o&m unit, Attibele sub-division.

Sl. No.	Particulars	Details
1	Name & Address of the Applicant	M/s Rajamma & Others GPA VRL Construction at Sy No 75/1 & 75/5 Ittangur village
2	Location of the installation	Sy No 75/1 & 75/5 Ittangur village to an extent of 150 Kva in Ittangur village in Sarjapura o&m unit, Attibele sub-division.
3	Type(Nature of Activity)	Apartment Building
4	Date of Registration of the Application in Sub-Division Office	
5	Date of receipt of the proposal in Division office	
6	Date of receipt of the proposal in Circle office	
7	Date of receipt of the proposal in Zonal Office.	
8	Whether the firm has been issued with NOC? If yes, please furnish the details & enclose the same (copy)	Yes
9	Whether Clause 9 is applicable, if yes; details in MS-Format shall also be furnished.	Yes
10	Requisitioned load details	150 KW
	a. Requisitioned Contract Demand/load	150 KW
	b. Voltage class	11 Kv/433Volts
	c. Tariff	
	d. Nature of the premises	Apartment Building
12	Regular Source Station details (Proposed)	
	Sub-Station Details	
	Name of the station	Voltage Class in KV
	66/11kV Dommasandra	66/11 KV
	Installed Capacity in MVA	Peak Load of the station (In MWs)
	2x31.5 MVA	18 MW
	Bank Details	
	Name of the Bank	Connected /Available CT Ratio
	Peak load of Bank (in MW)	Name of the Feeder
	B-1	1200/1
	11.8	F1 V kalhalli
		200/1A
		1.4
		F2-Dommasandra
		400/1A
		1.8
		F3-Agara
		400/1A
		2.3
		F4-Sarjapura(Agri)
		200/1A
		2.3
		F5-Neriga(Agri)
		400/1A
		2.1
		F11-Niranthar Jyothi
		200/1A
		400/1A
		0.1
		F-12- Trinity
		200/1A
		0.7
		F-13 -Ahad Builders
		200/1A
		1.1
		F-15 TC halli
		400/1A
		1.1
		F-17 APG Intelli Homes
		400/1A
		1.1
	Name of the Bank	Connected /Available CT Ratio
	Peak load of Bank (in MW)	Name of the Feeder
	B-2	1200/1
	7.1	F6-Sarjapura(U)
		400/1A
		2.5
		F7 - Vakil layout
		200/1A
		0.1
		F8- Stn Aux (HT)
		200/1A
		1.8
		F9 -Chambenahalli (Agri)
		400/1A
		1.1
		F10 - Wipro
		400/1A
		0.2
		F-14- Dommasandra (Agri)
		200/1A
		1.4
		F-16 Wipro SEZ project
		400/1A
		1.4
	Name of the Feeder on which the proposed load is to be catered	Peak load of the feeder (in MW)
	Size of the Conductor/ Cable	Length of the feeder in Km
	HTVR of the feeder before adding the proposed load	HTVR of the feeder after adding the proposed load
	Connected /Available CT Ratio	
Regular source	F1 V kalhalli	1.50
	400 Sqmm UG Cable/Coyote/ Rabbit	21
	4.83%	5.17%
	400/1 A	

1. For main source it is proposed of F1 V kalhalli Feeder by using 240 XLPE UG Cable for a distance of 100 mtrs from point A to point B as shown in the sketch.

2. It is proposed to erect LBS in the consumer premises under self execution works at Point E and It is proposed to erection of 01 Nos of 250 KVA Transformer Point F as shown in the sketch.

3. It is proposed to erect 11mtr spun pole with 400A D/B GOS to F1 V kalhalli feeder at point A as shown in the sketch.

4. There is no existing RRNs.

Certificate:	1. Certified that there is No EHT line passing inside this premises.
	2. Certified that there is No HT/LT line passing inside this premises.
	3. Certified that there is No IP-set installation inside the premises.
	4. Certified that there is No arrears outstanding inside the premises.

Asst. Executive Engineer (Elec)
C, O&M ATTIBELE Sub-Division,

Asst. Engineer (Elec)
BESCOM, O&M- Sarjapura
Attibele Sub-Division,

Executive Engineer(Elec)
C, O&M Division, BESCOM



ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ಕಂಪನಿ ನಿಯಮಿತ

BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

PROFORMA

Arranging power supply to New Installation/Issuing NOC for M/s Rajamma & Others GPA VRL Construction at Sy No 75/1 & 75/5 Ittangur village to an extent of 150 Kva in Ittangur village in Sarjapura o&m unit,Attibele sub-division.


Applicable for arranging power supply to issuing NOC

SL.NO.	PARTICULARS	DETAILS
1	Name & Address of the Applicant	M/s Rajamma & Others GPA VRL Construction at Sy No 75/1 & 75/5 Ittangur village
2	Location of the installation	Sy No 75/1 & 75/5 Ittangur village to an extent of 150 Kva in Ittangur village in Sarjapura o&m unit,Attibele sub-division.
3	Type (Nature of Activity)	Apartment Building
4	Date of Registration of the application in sub-division office	
5	Date of receipt of the proposal in division office	
6	Date of receipt of the proposal in Circle office	
7	Date of receipt of the proposal in Zonal office	
8	Whether the firm has been issued with NOC? If yes,please furnish the details & enclose the same(copy)	
9	Whether the clause 9 is applicable,if yes details in MS format shall also be furnish	
10	Requisitioned contract Details:	150 kw
	a.Requisitioned contract Demand/Load	150 kw
	b.Voltage class	440/233 Volts.
	c.Tariff	
	d.Nature of the premises	Apartment Building

Asst. Engineer (Elec)
BESCOM, O&M- Sarjapura
Attibele Sub-Division,

Asst. Executive Engineer(Elec)
C,O&M Attibele Sub-Division,

Arranging power supply to New Installation/Issuing NOC for M/s Rajamma & Others GPA VRL Construction at Sy No 75/1 & 75/5 Ittangur village to an extent of 150 Kva in Ittangur village in Sarjapura o&m unit, Attibele sub-division.

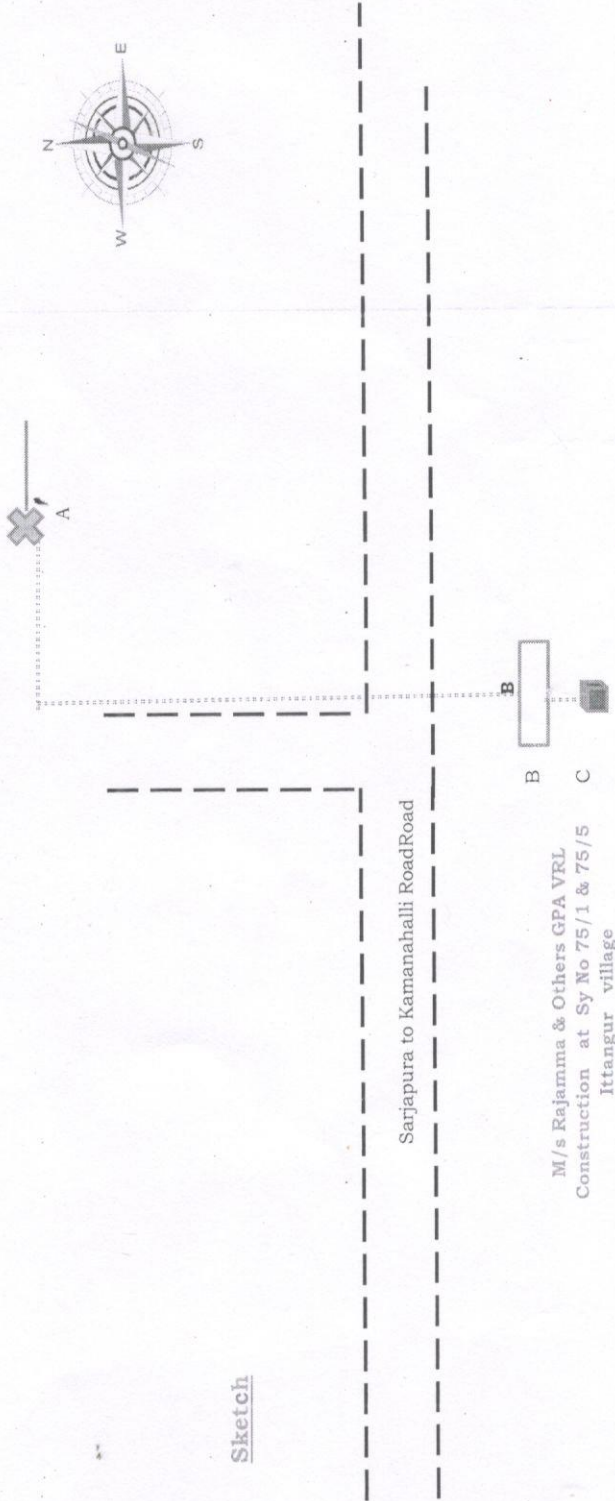

Index

Existing F01 of 66/11KV Dommasandra MUSS having 400ams UG Cable, Coyote Conductor



Existing 11Mtrs long Spun Pole Structure with proposed 200A S/B GOS at Point A

Proposed 400 mtrs 1x250 Sqmm XLPE HTUG Cable at point A to B



Proposed point RLE and 1x250KVA 5 Star Rated Cable entry Type Distribution Transformers at Point C

[Signature]

Assistant Engineer(Ele)
Sarjapura O&M Section
Attibele Sub division

[Signature]
Assistant Executive Engineer(Ele)
Attibele Sub division
BESCOM, Attibele.



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED / ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ಕಂಪನಿ ನಿಯಮಿತ

Attibele Online 1

ರಸೀದಿ / RECEIPT

ರಸೀದಿ ಸಂಖ್ಯೆ
Receipt No.
ಬಳಕೆದಾರನ ಸಂಖ್ಯೆ
Consumer I.D. No.
ಬಿಲ್ಲಿನ ಸಂಖ್ಯೆ
Bill No.
ಇವರಿಂದ
Received From
ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ
Amount in Words

20230021296

5689/

RAJAMMA & OTHERS GPA VRL

Rupees Five Thousand Onl

y

ದಿನಾಂಕ
Date
ವಿಧ
Type
ಬಿಲ್ಲಿನ ದಿನಾಂಕ
Bill Date
ಮೊತ್ತ (ರೂ.)
Amount in Rs.
ಪಾವತಿ ವಿಧಾನ/
Payment Mode

18/10/2023 15:06

Others

5000.00

Cash Cash Cheque DD

ದಯವಿಟ್ಟು ಕೌಂಟರ್ ಬಿಡುವ ಮೊದಲು ಮೊಬಲಗು ಮೊತ್ತ ಮತ್ತು ಬಿಡಿ.ನಂ. ಅನ್ನು ಪರಿಶೀಲಿಸಿ
Before leaving the counter please check the Amount & ID No.

00411RAJAMMA32383ZuzuD91Rx30xn9635Z

Signature of the Cashier
Bhuvanani



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED / ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ಕಂಪನಿ ನಿಯಮಿತ

Attibele Online 1

ರಸೀದಿ / RECEIPT

ರಸೀದಿ ಸಂಖ್ಯೆ
Receipt No.
ಬಳಕೆದಾರನ ಸಂಖ್ಯೆ
Consumer I.D. No.
ಬಿಲ್ಲಿನ ಸಂಖ್ಯೆ
Bill No.
ಇವರಿಂದ
Received From
ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ
Amount in Words

20230021297

5689/0

RAJAMMA & OTHERS GPA VRL

Rupees Four Hundred Fifty

Only

ದಿನಾಂಕ
Date
ವಿಧ
Type
ಬಿಲ್ಲಿನ ದಿನಾಂಕ
Bill Date
ಮೊತ್ತ (ರೂ.)
Amount in Rs.
ಪಾವತಿ ವಿಧಾನ/
Payment Mode

18/10/2023 15:06

CGST 9%

450.00

Cash Cash Cheque DD

ದಯವಿಟ್ಟು ಕೌಂಟರ್ ಬಿಡುವ ಮೊದಲು ಮೊಬಲಗು ಮೊತ್ತ ಮತ್ತು ಬಿಡಿ.ನಂ. ಅನ್ನು ಪರಿಶೀಲಿಸಿ
Before leaving the counter please check the Amount & ID No.

00411RAJAMMA32383Zu40zuD91Rx30xn9735Z

Signature of the Cashier
Bhuvanani



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED / ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ಕಂಪನಿ ನಿಯಮಿತ

Attibele Online 1

ರಸೀದಿ / RECEIPT

ರಸೀದಿ ಸಂಖ್ಯೆ
Receipt No.
ಬಳಕೆದಾರನ ಸಂಖ್ಯೆ
Consumer I.D. No.
ಬಿಲ್ಲಿನ ಸಂಖ್ಯೆ
Bill No.
ಇವರಿಂದ
Received From
ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ
Amount in Words

20230021298

5689/0

RAJAMMA & OTHERS GPA VRL

Rupees Four Hundred Fifty

Only

ದಿನಾಂಕ
Date
ವಿಧ
Type
ಬಿಲ್ಲಿನ ದಿನಾಂಕ
Bill Date
ಮೊತ್ತ (ರೂ.)
Amount in Rs.
ಪಾವತಿ ವಿಧಾನ/
Payment Mode

18/10/2023 15:06

SGST 9%

450.00

Cash Cash Cheque DD

ದಯವಿಟ್ಟು ಕೌಂಟರ್ ಬಿಡುವ ಮೊದಲು ಮೊಬಲಗು ಮೊತ್ತ ಮತ್ತು ಬಿಡಿ.ನಂ. ಅನ್ನು ಪರಿಶೀಲಿಸಿ
Before leaving the counter please check the Amount & ID No.

00411RAJAMMA32383Zu40zuD91Rx30xn9835Z

Signature of the Cashier
Bhuvanani