



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED
(Wholly owned Government of Karnataka undertaking)

EEE/WF/AEE(O)/NOC/AET/ 2023-24/ 463-64

Encl:

Office of the
Executive Engineer (Ele)
Whitefield Division, BESCOM.,
Whitefield, Bangalore-66

To

M/s. Saranya Builders Rep. by Mr. Y. Madhu,
Sy.No. 81A, 81B, 78A, 78B, Kumbena Agrahara Village,
Bidarahalli Hobli, Kadugodi, Bangalore-560067.

Dtd: 26/5/23

Sir,

Sub:- Issue of NOC for arranging power supply of 400KW(470 KVA)
to the Proposed **Residential Building** in- M/s. Saranya Builders Rep. by Mr. Y.
Madhu, Sy.No. 81A, 81B, 78A, 78B, Kumbena Agrahara Village, Bidarahalli Hobli,
Kadugodi, Bangalore-560067in Kadugodi O&M, E4 sub division.

Ref:- AEEE/ESD4/AE(T)/23-24/348 /dt. 23.05.2023.

With reference to the above, 'No Objection Certificate' from Whitefield Division, **BESCOM** is hereby issued for arranging power supply to an extent of 400KW(470 KVA) to the Proposed **Residential Building** in- M/s. Saranya Builders Rep. by Mr. Y. Madhu, Sy.No. 81A, 81B, 78A, 78B, Kumbena Agrahara Village, Bidarahalli Hobli, Kadugodi, Bangalore-560067in Kadugodi O&M, E4 sub division subject to the following conditions:

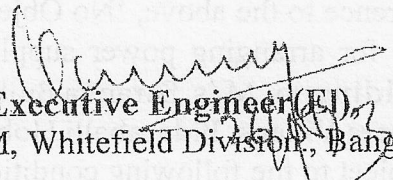
1. Power supply to your proposed **Residential Building** will be arranged with the following arrangements.
 - a. Regular Source: The existing F-01 feeder from 66/11 KV Kadugodi MUSS & by laying of 11KV power supply through 3X95sq.mm XLPE HTUG Cable to a distance of 0.35Kms with rings and rise and terminated inside the consumer premises, then it's proposed to provide 4-Way DAS Compatible RMU to HT Metering cubicle or 1X500KVA Oil Type DTC respectively.
 - b. Alternate Source: The existing F-15 feeder from 66/11 KV Kadugodi MUSS & by laying of 11KV power supply through 3X95sq.mm XLPE HTUG Cable to a distance of 0.45Kms with rings and rise terminated inside the consumer premises.
 - c. Presently, there are no 11KV/LT lines are passing through the premises. Hence no change over power supply available.
2. If any KPTCL/BESCOM lines are passing through the applicant's premises these shall be shifted at your cost. This NOC does not apply to the premises where EHT lines are passing through the premises for which NOC is to be obtained from the concerned authorities.

For SARANYA BUILDERS

Y. Madhu


3. If any installation is existing, the same shall be surrendered by clearing all arrears before taking up infrastructure work in the premises.
4. While applying for power supply to the said **Residential Building** at the above address, all regulations as per KERC conditions of supply of Distribution licensee in the state of Karnataka to be followed.
5. Power supply shall be arranged to the said **Residential Building** based on the provisions of regulations of KERC is applicable at that time.
6. This "NOC" is issued only for the purpose of obtaining sanction plan for **Residential Building** from BDA/BBMP/Competent authorities and is not a commitment for power sanction from BESCOM. Power supply will be sanctioned when applied for, subject to feasibility at that time.
7. The approximate load requirement of the above **Residential Building** is 400KW/470 KVA.
8. This NOC is valid for a period of **Two years** from the date of issue. Rs. 5900/- collected vide Rt. No. 939385655781 dtd. 17.05.2023 towards issued of NOC.
9. No I.T/HT installation exists or LT/HT lines passing inside applicant's premises.

Yours faithfully,


Executive Engineer(EI),
BESCOM, Whitefield Division, Bangalore.

Copy to the Asst. Exe. Engineer (EI), F4 sub division, BESCOM, White field, Bangalore for information.

For SARANYA BUILDERS


Managing Partner