


		PARKING TABLE		PROVIDED	
		REQUIRED	GROUND FLOOR	BASEMENT	TOTAL
	COMMERCIAL				
VISITOR PARKING	66.99	48.65	59.22	106.87	TOTAL
OTHER PARKING	103.49	-----	131.77	131.77	
CAR PARKING	172.48	-----	242.13	242.13	
TOTAL (COMMERCIAL)	342.96	48.65	432.12	480.77	

THE FIRE PROTECTION SYSTEM :-

1. All Basements Parking and HPP will be Fully Sprinklered.
2. All Lower Basements Should have Positive Pressure Ventilation.
3. Electric Cable Shaft Should have Fire Resistant Doors.
4. The Staircase & Lift Shafts in Basement Shall To Be Protected By 2 Hrs Fire Resistance Construction including The Doors.

ONSC WELL

(7)

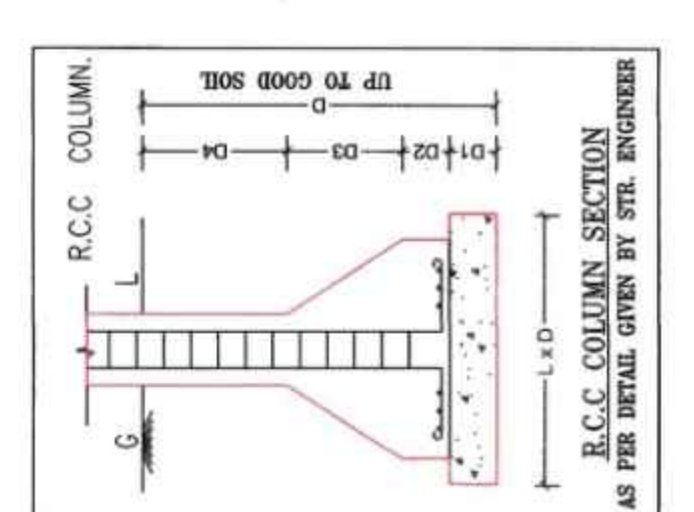

12.00 MT. WIDE T.P.S. ROAD

GROUND LEVEL PARKING LAY OUT PLAN
[SCALE:- 1:00 CM = 2.00 MT.]



AUTHORITY:-

[illegible][illegible]