


| | | |
|----------|------|----------|
| ... | ... | ... |
| rev. no. | date | revision |

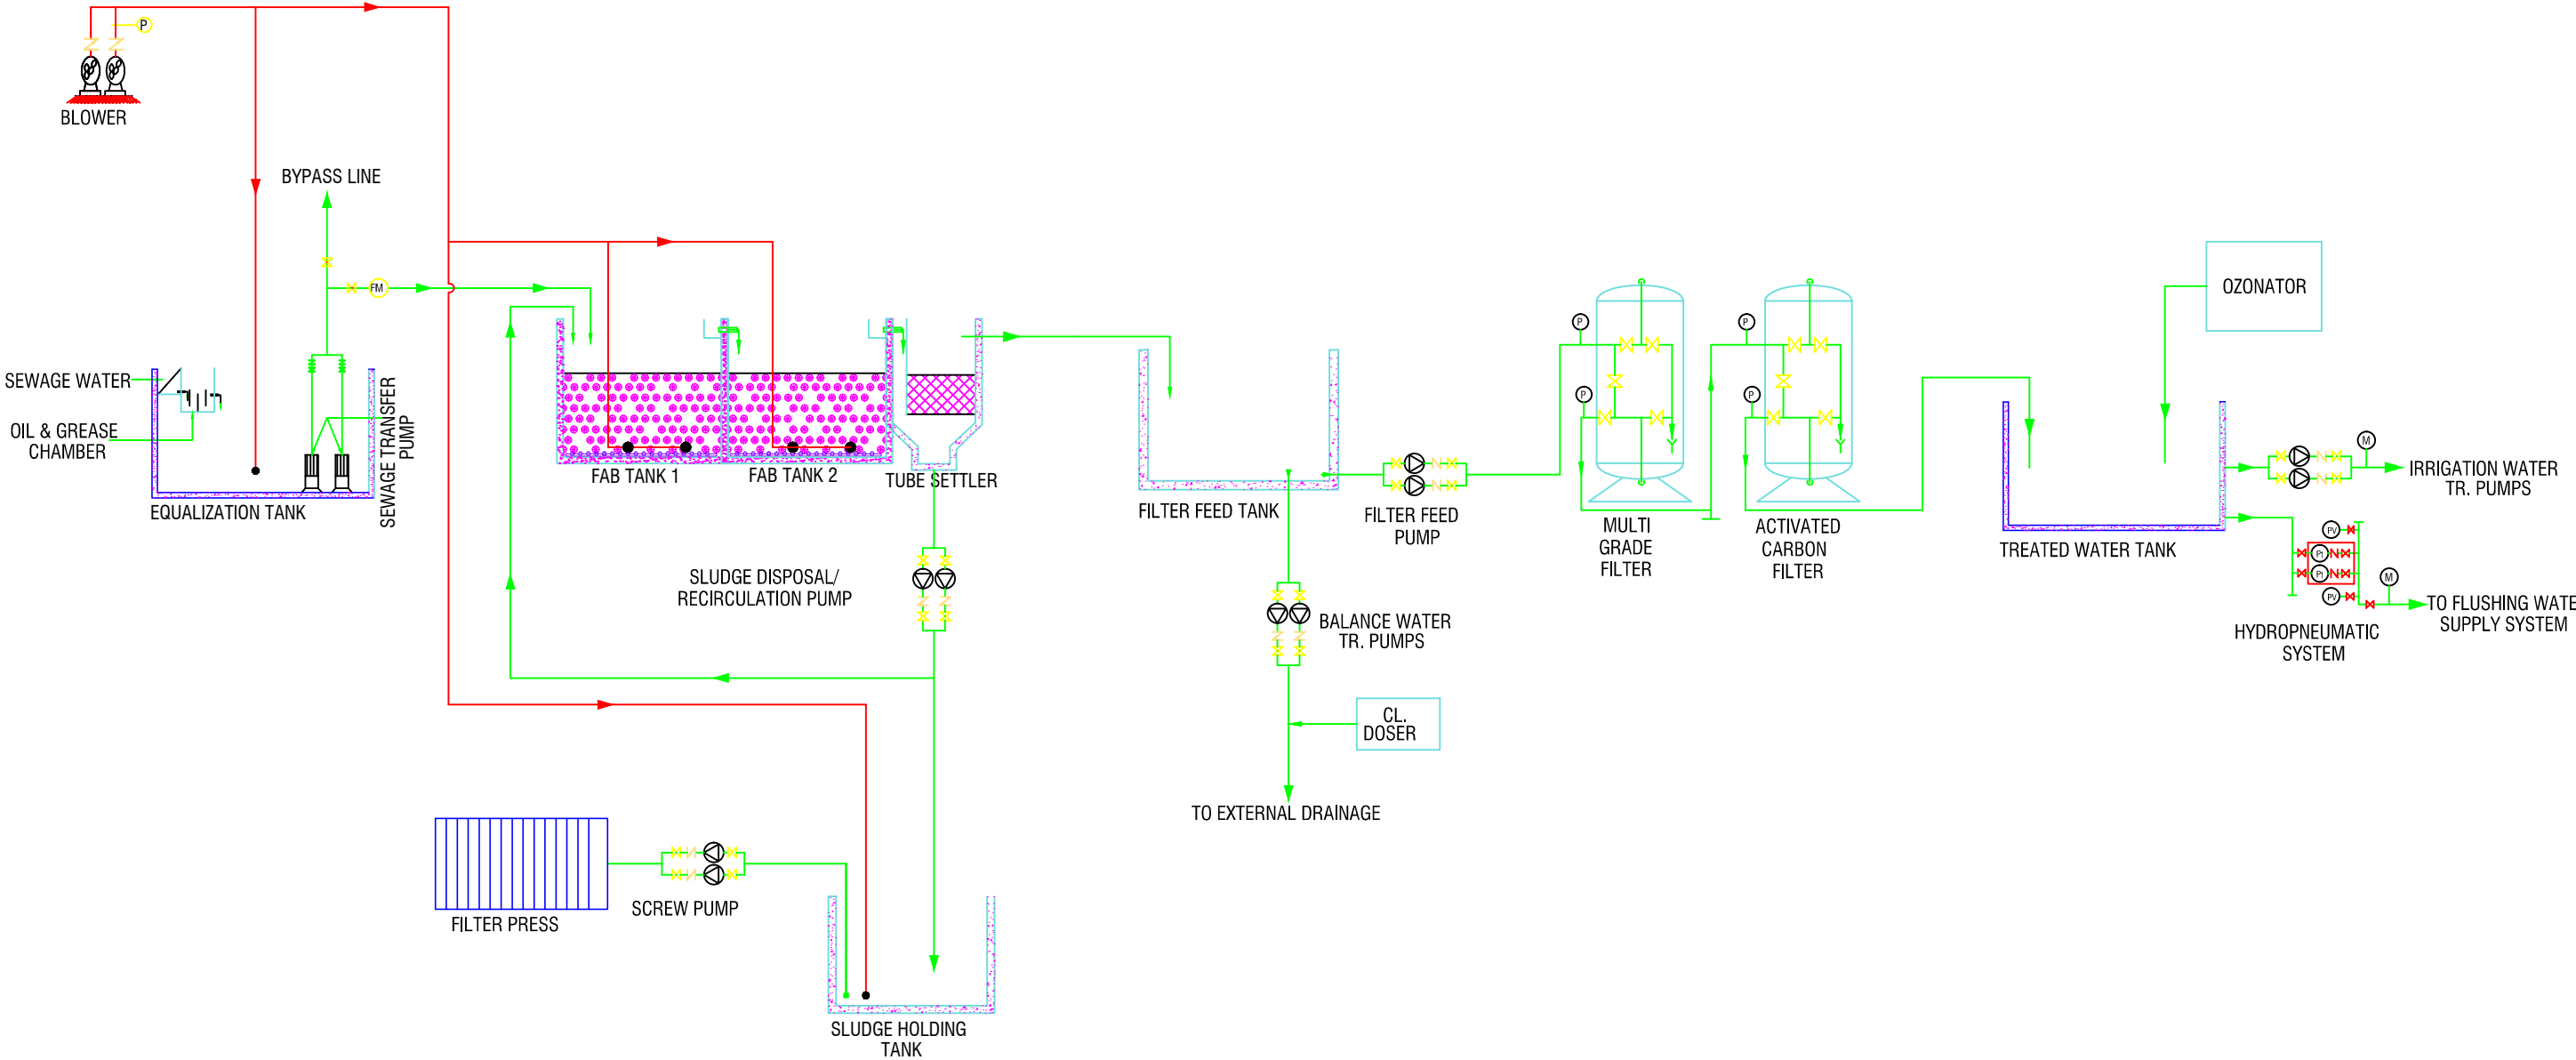

SEWAGE TREATMENT PLANT CAPACITY = 110 KLD

LEGEND :

- VALVE
- NON RETURN VALVE
- DIFFUSER
- PRESSURE GAUGE
- WATER METER
- FLOW METER

| | |
|---------|--|
| project | Proposed Residential Building at plot No. SC-01/ C-A7 Sector- 150 Noida U.P. |
| title | SCHEMATIC FLOW DIAGRAM SEWAGE TREATMENT PLANT |

| | | | |
|----------|-----------|--------------|---------------|
| drg. no. | STP-01 | released for | SUBMISSION |
| date | Nov. 2016 | drawn by | SHIKHA |
| scale | N.T.S. | ckd by | Anand Havelia |

| | |
|----------|---------------------------------|
| OWNER :- | M/S - ELICIT REALTECH PVT. LTD. |
|----------|---------------------------------|

| | |
|---------------------|--|
| services consultant | Consummate Engineering Services (P) Ltd. |
| | Noida Office : B - 67, Sector - 67, Noida - 201 301, Tel : (0120) 6943500 (23 Lines) Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow, Tel : (0522) 6515455 e mail : mail@cespl.in, website : www.cespl.in |